



PRELIMINARY AIR MONITORING SUMMARY

Jenkintown, PA
SPS Technologies Fire
February 24-25, 2025

Submitted February 26, 2025

1.0 INTRODUCTION

On February 19, 2025, CTEH was contacted to provide community air monitoring for SPS Technologies, LLC in conjunction with the United States Environmental Protection Agency (USEPA) and the Pennsylvania Department of Environmental Protection (PA DEP). CTEH initially established seven stationary real-time air monitoring locations in a perimeter around the SPS Technologies facility and adjacent residential areas on the morning of February 20, 2025. Real-time air monitoring performed by CTEH began at 1208 EST on February 20, 2025. At 1000 EST on February 22, 2025, CTEH established a Kestrel 6000 cellular weather station approximately 500 feet north of the facility. On the evening of February 22, 2025, CTEH established four additional stationary monitoring locations in community areas around the facility. Consistent with the updated Air Sampling and Analysis Plan (SAP) submitted on February 23, 2025, CTEH established two additional community stationary monitoring locations on both February 23 and February 24, 2025, bringing the total number of stationary monitoring locations to fifteen. These stationary real-time monitoring locations were established to encompass a 360° monitoring perimeter around the facility and within nearby communities.

This report summarizes real-time air monitoring data collected by CTEH personnel from 0600 EST on February 24, 2025 to approximately 0600 EST on February 25, 2025.

2.0 AIR MONITORING METHODS

Real-time air monitoring refers to the use of direct-reading instruments to provide a near-instantaneous readout of chemical concentrations in the air. On February 19, 2025, CTEH personnel developed a SAP to document and quantify the potential release of fugitive emissions from the incident. CTEH has continued to update the SAP and associated monitoring locations based on feedback from PA DEP. The analytes chosen for air monitoring were coordinated with representatives from USEPA and PA DEP for this incident based on the Tier II documentation for the SPS Technologies Facility.

Handheld real-time air monitoring refers to data collected by roaming CTEH personnel using handheld air monitoring instruments. Stationary real-time air monitoring refers to stationary instruments that record air monitoring data approximately every 15 seconds and send the data in real time to a centralized location via radio telemetry. Handheld and Stationary real-time air monitoring were conducted using RAE® Systems by Honeywell MultiRAE Pro and AreaRAE instruments equipped with 10.6 eV photoionization detectors and multiple electrochemical sensors, ChemLogic CLPx portable gas detectors, and Gastec GV-100 pumps equipped with chemical-specific, colorimetric detector tubes. These include volatile organic compounds (VOCs), hydrogen cyanide (HCN), hydrogen sulfide (H₂S), chlorine (Cl₂), carbon monoxide (CO), sulfuric acid, nitric acid, and flammability as a percentage of the lower explosive limit

(%LEL). Additionally, handheld and stationary real-time air monitoring for particulate matter of 2.5 μm diameter or less ($\text{PM}_{2.5}$) was conducted using TSI SidePak AM520 instruments.

Stationary air monitoring equipment is subject to drift events, which are defined as any interference in an instrument's photoionization detector (PID; 10.6 eV) or electrochemical sensor's ability to accurately report the concentration of a chemical in the atmosphere. Common sources of drift include impacts from humidity, temperature changes, and issues with instrument batteries. These drift sources may cause air monitoring equipment to report consistent, low-level detections in the absence of chemicals present in the air.

In total, CTEH has established fifteen stationary real-time air monitoring locations as part of this response. Six air monitoring stations were installed around the perimeter of the impacted facility. The remaining nine monitoring stations were established in the communities surrounding the impacted facility, including schools and parks. These locations include Baederwood Park, the Glenside Youth Athletic Club Baseball Fields, the Noble Train Station, Jenkintown Middle/High School, Salus University, Thomas Williams Park, Curtis Arboretum, Arcadia University, and Glenn Memorial Hall.

3.0 AIR MONITORING RESULTS

Maps of the incident location, real-time air monitoring results, and the locations of stationary real-time air monitoring locations are provided in **Attachment A**. The results of handheld real-time air monitoring are summarized in **Table 1**. The results of stationary real-time air monitoring from the perimeter locations are summarized in **Tables 2 and 3**. The results of the stationary real-time air monitoring from the community locations are summarized in **Tables 5 and 6**. Visual depictions of the stationary real-time air monitoring data from the perimeter locations are provided in **Attachment B**. Visual depictions of the stationary real-time air monitoring data from the community locations are provided in **Attachment C**. A wind rose depicting wind direction and wind speed during this reporting period is provided in **Attachment D**. Meteorological data were acquired from both the PHILADELPHIA NE weather station in Philadelphia, PA, and a Kestrel 6000 cellular weather station located approximately 500 feet north of the facility.

3.1 Handheld Real-Time Air Monitoring Results

Table 1: Handheld Real-Time Perimeter and Expanded Community Air Monitoring Results[†]

Analyte*	Instrument	Number of Readings	Number of Detections	Concentration Range**
Cl ₂	Gastec 8La	99	0	< 0.05 ppm
	MultiRAE	84	0	< 0.1 ppm
H ₂ S	MultiRAE	13	0	< 0.1 ppm
HCN	Gastec #12L	36	0	< 0.1 ppm
	MultiRAE	17	0	< 1 ppm
Nitric Acid	CLPx	3	0	< 12.5 ppb
	Gastec #15L	88	0	< 0.05 ppm
Sulfuric Acid	CLPx	21	0	< 23.3 ppb
	Gastec #35	64	0	< 0.2 mg/m ³
VOCs	MultiRAE	2	0	< 0.1 ppm

[†]Note: This is a preliminary data summary, indicating that the data provided have not undergone full quality assurance and quality control (QA/QC) process and should be considered preliminary at this time.

*Gastec measurements for nitric oxide and nitrogen dioxide were utilized during this reporting period as a QA/QC evaluation of humidity interference on Gastec tubes and are not reported in this data table. There were no detections of either analyte during this evaluation.

**If no detectable concentration was observed, the instrument detection limit is preceded by a "<" symbol.

There were no detections of any analyte evaluated during Handheld Perimeter Air Monitoring or Handheld Community Air Monitoring in this reporting period.

3.2 Stationary Real-Time Perimeter Air Monitoring Results

Table 2. Summary of Stationary Real-Time Perimeter Air Monitoring AreaRAE Results[†]

Unit	Analyte	Number of Readings	Number of Detections	Concentration Range*
Station 01	CO	5,940	0	< 1.0 ppm
	H ₂ S	5,940	0	< 0.1 ppm
	HCN	5,940	0	< 1.0 ppm
	%LEL	5,940	0	< 1.0 %
	VOCs	5,940	815	0.1 - 0.2 ppm
Station 03	CO	5,906	15	2.0 - 10.0 ppm
	H ₂ S	5,906	0	< 0.1 ppm
	HCN	5,906	0	< 1.0 ppm
	%LEL	5,906	0	< 1.0 %
	VOCs	5,906	505	0.1 - 5.1 ppm
Station 04	CO	5,879	0	< 1.0 ppm

	H ₂ S	5,879	0	< 0.1 ppm
	HCN	5,879	0	< 1.0 ppm
	%LEL	5,879	0	< 1.0 %
	VOCs	5,879	8	0.1 ppm
Station 05	CO	5,934	0	< 1.0 ppm
	H ₂ S	5,934	0	< 0.1 ppm
	HCN	5,934	0	< 1.0 ppm
	%LEL	5,934	0	< 1.0 %
	VOCs	5,934	10	0.1 - 0.2 ppm
Station 06	CO	5,987	0	< 1.0 ppm
	H ₂ S	5,987	0	< 0.1 ppm
	HCN	5,987	0	< 1.0 ppm
	%LEL	5,987	0	< 1.0 %
	VOCs	5,987	1	0.1 ppm
Station 07	CO	5,965	0	< 1.0 ppm
	H ₂ S	5,965	0	< 0.1 ppm
	HCN	5,965	0	< 1.0 ppm
	%LEL	5,965	0	< 1.0 %
	VOCs	5,965	140	0.1 - 0.5 ppm

†Note: This is a preliminary data summary, indicating that the data provided have not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time. AreaRAE monitoring data contain drift events. Drift is defined as any interference in an instrument's photoionization detector (PID; 10.6 eV) or electrochemical sensor's ability to accurately report the concentration of a chemical in the atmosphere. Humidity, rapid temperature changes, and compromised instrument batteries are examples of common sources of drift.

* If no detection was observed, the instrument detection limit preceded by a "<" symbol is listed; ppm = parts per million

Table 3: Summary of Stationary Real-Time Perimeter Air Monitoring PM_{2.5} Results[†]

Unit	Instrument	24-Hour PM _{2.5} NAAQS	Average PM _{2.5} Concentration (mg/m ³)
Station 1	AM520	0.035	0.023
Station 3	AM520	0.035	0.020
Station 4	AM520	0.035	0.020
Station 5	AM520	0.035	0.022
Station 6	AM520	0.035	0.023
Station 7	AM520	0.035	0.029

†Note: This is a preliminary data summary, indicating that the data provided have not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time.

Stationary real-time monitoring at six locations around the perimeter of the facility indicated that there were no detections of H₂S, HCN, or %LEL during the reporting period. Transient low-level detections of CO

were observed at Station 3. There were no elevated average PM_{2.5} concentrations observed in the perimeter monitoring locations during this reporting period.

3.3 Stationary Real-Time Expanded Community Air Monitoring Results

Table 4. Summary of Stationary Real-Time Expanded Community Air Monitoring AreaRAE Results[†]

Unit	Analyte	Number of Readings	Number of Detections	Concentration Range*
Station 02	CO	5,986	0	< 1.0 ppm
	H ₂ S	5,961	0	< 0.1 ppm
	HCN	5,986	0	< 1.0 ppm
	%LEL	5,986	0	< 1.0 %
	VOCs	5,986	25	0.3 - 0.4 ppm
Station 08	CO	5,151	0	< 1.0 ppm
	H ₂ S	5,151	0	< 0.1 ppm
	HCN	5,151	0	< 1.0 ppm
	%LEL	5,151	0	< 1.0 %
	VOCs	5,151	78	0.1 ppm
Station 09	CO	5,328	0	< 1.0 ppm
	H ₂ S	5,328	0	< 0.1 ppm
	HCN	5,328	0	< 1.0 ppm
	%LEL	5,328	0	< 1.0 %
	VOCs	5,328	1,908	0.1 - 0.5 ppm
Station 10	CO	5,220	0	< 1.0 ppm
	H ₂ S	5,220	0	< 0.1 ppm
	HCN	5,220	0	< 1.0 ppm
	%LEL	5,220	0	< 1.0 %
	VOCs	5,220	0	< 0.1 ppm
Station 11	CO	5,208	0	< 1.0 ppm
	H ₂ S	5,208	0	< 0.1 ppm
	HCN	5,208	0	< 1.0 ppm
	%LEL	5,208	0	< 1.0 %
	VOCs	5,208	47	0.1 ppm
Station 12	CO	5,292	4	2.0 - 3.0 ppm
	H ₂ S	5,292	0	< 0.1 ppm
	HCN	5,292	0	< 1.0 ppm
	%LEL	5,292	0	< 1.0 %
	VOCs	5,292	448	0.1 ppm
Station 13	CO	5,125	0	< 1.0 ppm
	H ₂ S	5,125	0	< 0.1 ppm

	HCN	5,125	0	< 1.0 ppm
	%LEL	5,125	0	< 1.0 %
	VOCs	5,125	112	0.1 ppm
Station 14	CO	2,736	0	< 1.0 ppm
	H ₂ S	2,736	0	< 0.1 ppm
	HCN	2,736	0	< 1.0 ppm
	%LEL	2,736	0	< 1.0 %
	VOCs	2,736	0	< 0.1 ppm
Station 15	CO	2,962	2	2.0 - 4.0 ppm
	H ₂ S	2,962	0	< 0.1 ppm
	HCN	2,962	0	< 1.0 ppm
	%LEL	2,962	0	< 1.0 %
	VOCs	2,962	0	< 0.1 ppm

†Note: This is a preliminary data summary, indicating that the data provided have not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time. AreaRAE monitoring data contain drift events. Drift is defined as any interference in an instrument's photoionization detector (PID; 10.6 eV) or electrochemical sensor's ability to accurately report the concentration of a chemical in the atmosphere. Humidity, rapid temperature changes, and compromised instrument batteries are examples of common sources of drift.

* If no detection was observed, the instrument detection limit preceded by a "<" symbol is listed; ppm = parts per million

Table 5: Summary of Stationary Real-Time Expanded Community Air Monitoring PM_{2.5} Results †

Unit	Instrument	24-Hour PM _{2.5} NAAQS	Average PM _{2.5} Concentration (mg/m ³)
Station 2	AM 520	0.035	0.025
Station 8	AM520	0.035	0.021
Station 9	AM520	0.035	0.019
Station 10	AM520	0.035	0.020
Station 11	AM520	0.035	0.014
Station 12	AM520	0.035	0.022
Station 13	AM520	0.035	0.021
Station 14	AM520	0.035	0.014
Station 15	AM520	0.035	0.012

†Note: This is a preliminary data summary, indicating that the data provided have not undergone full quality assurance and quality control (QAQC) process and should be considered preliminary at this time.

Stationary real-time monitoring at nine locations in communities surrounding the facility indicated no detections of H₂S, HCN, or % LEL. Transient low-level detections of CO were observed at Station 12 and 15. There were no elevated average PM_{2.5} concentrations observed in the community monitoring locations during this reporting period.

4.0 METEOROLOGICAL CONDITIONS

Attachment D contains wind roses depicting wind speed and direction from station PHILADELPHIA NE, approximately 6.89 miles from the site, and a Kestrel 6000 cellular monitoring station located approximately 500 feet north of the facility.



Attachment A

Maps




SPS Technologies Fire


Incident Location
Abington Township, PA | Montgomery
County
PROJ-052216

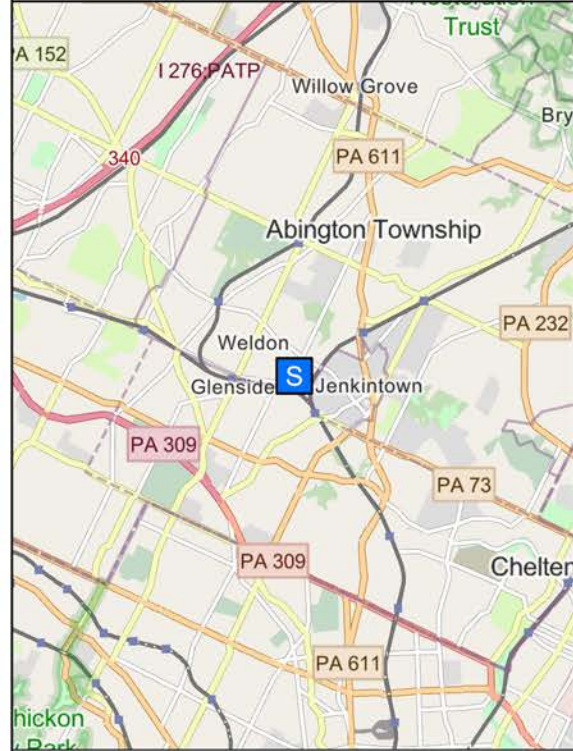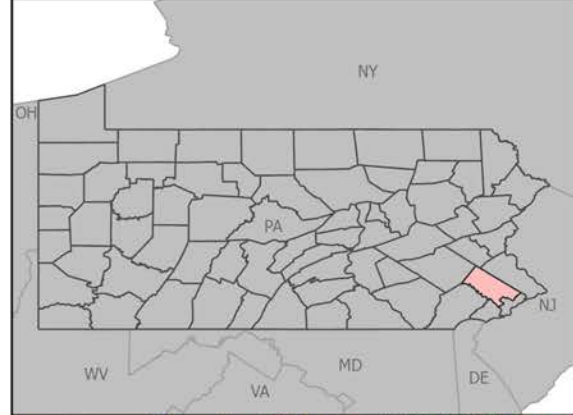



Updated At: 2/20/2025 4:59 PM

Projection: NAD 1983 2011 StatePlane Pennsylvania South
FIPS 3702

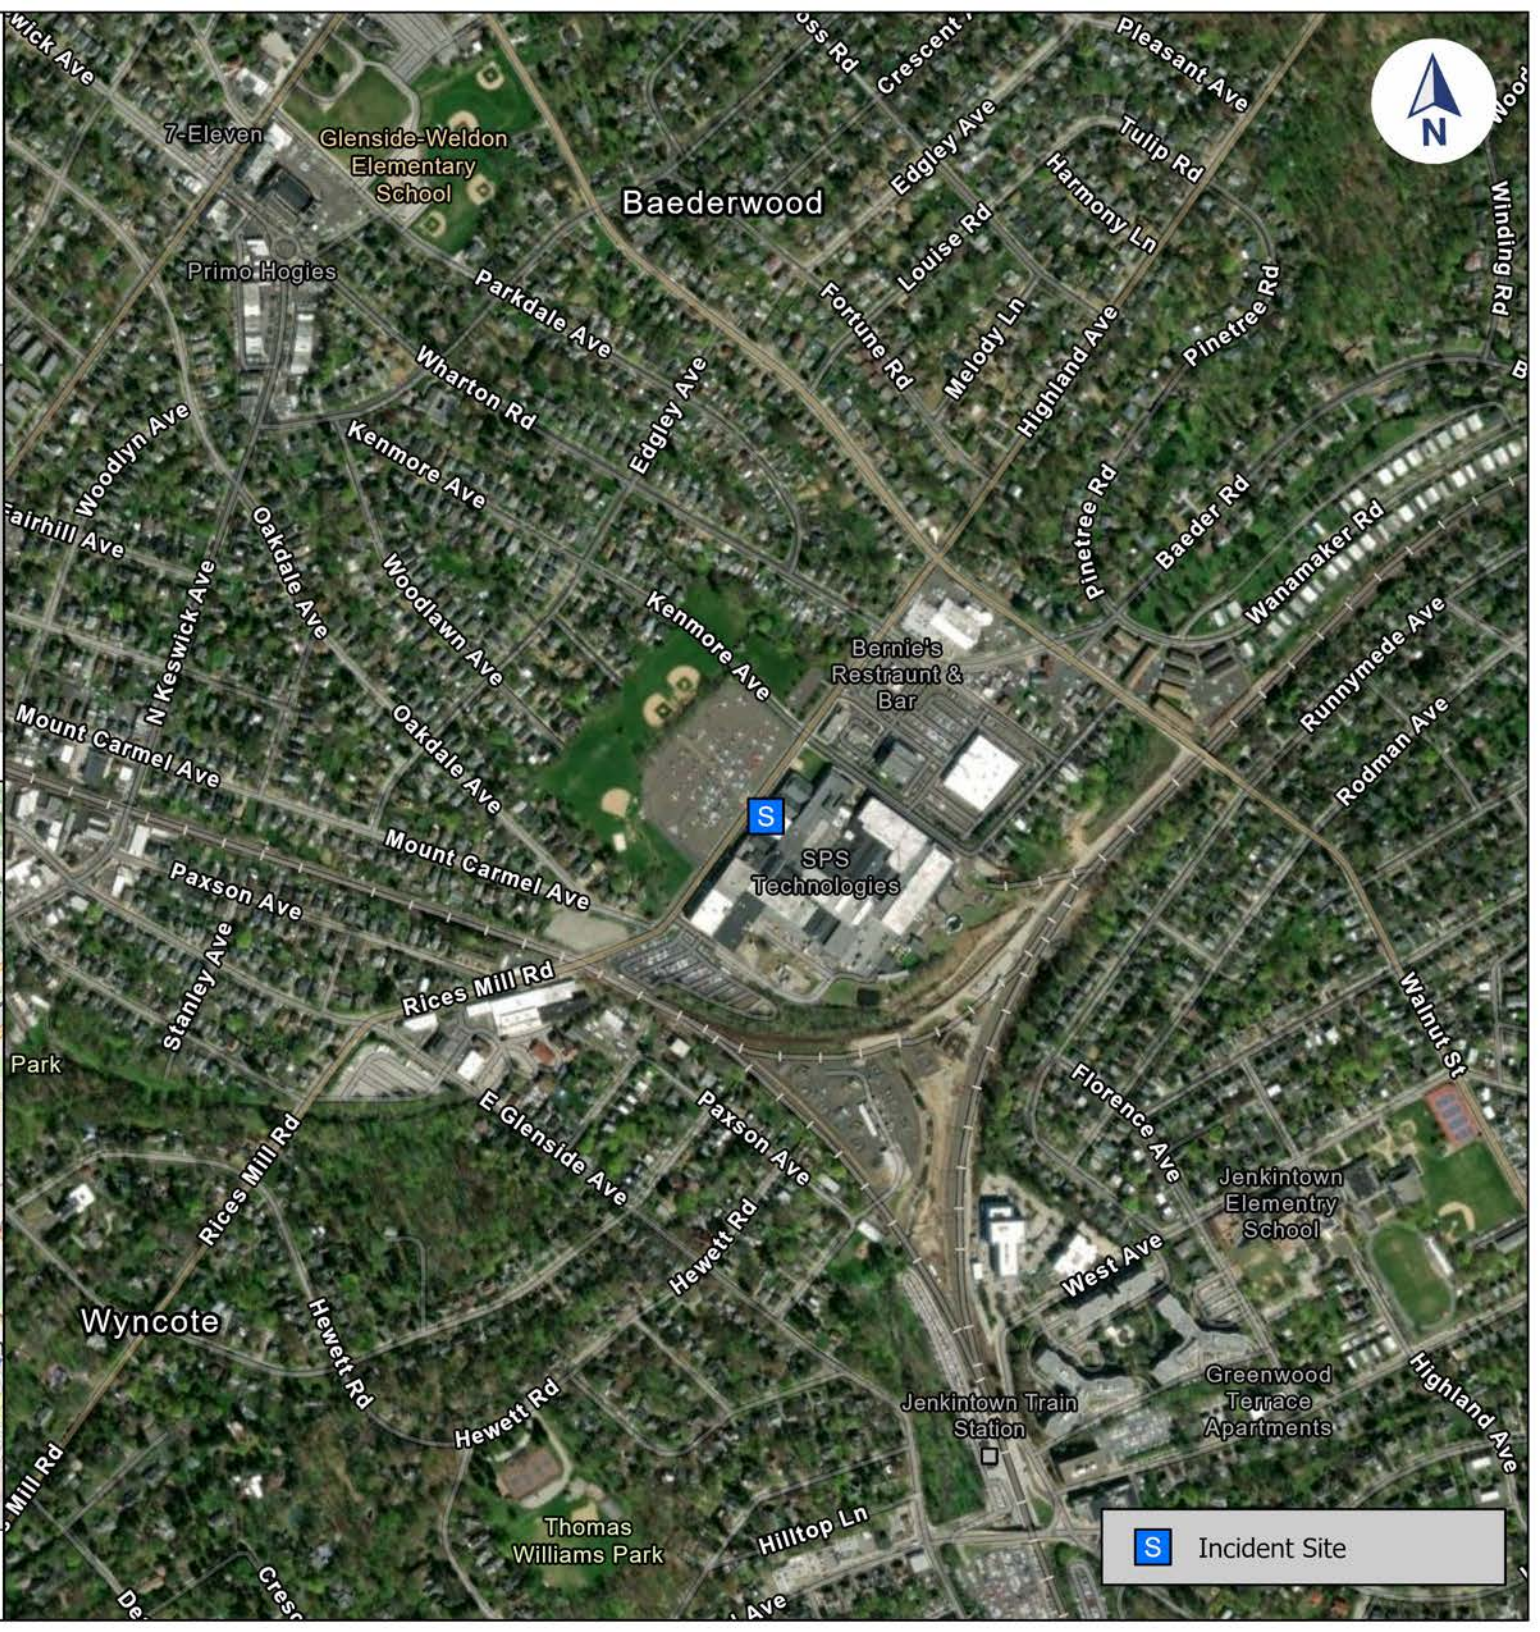




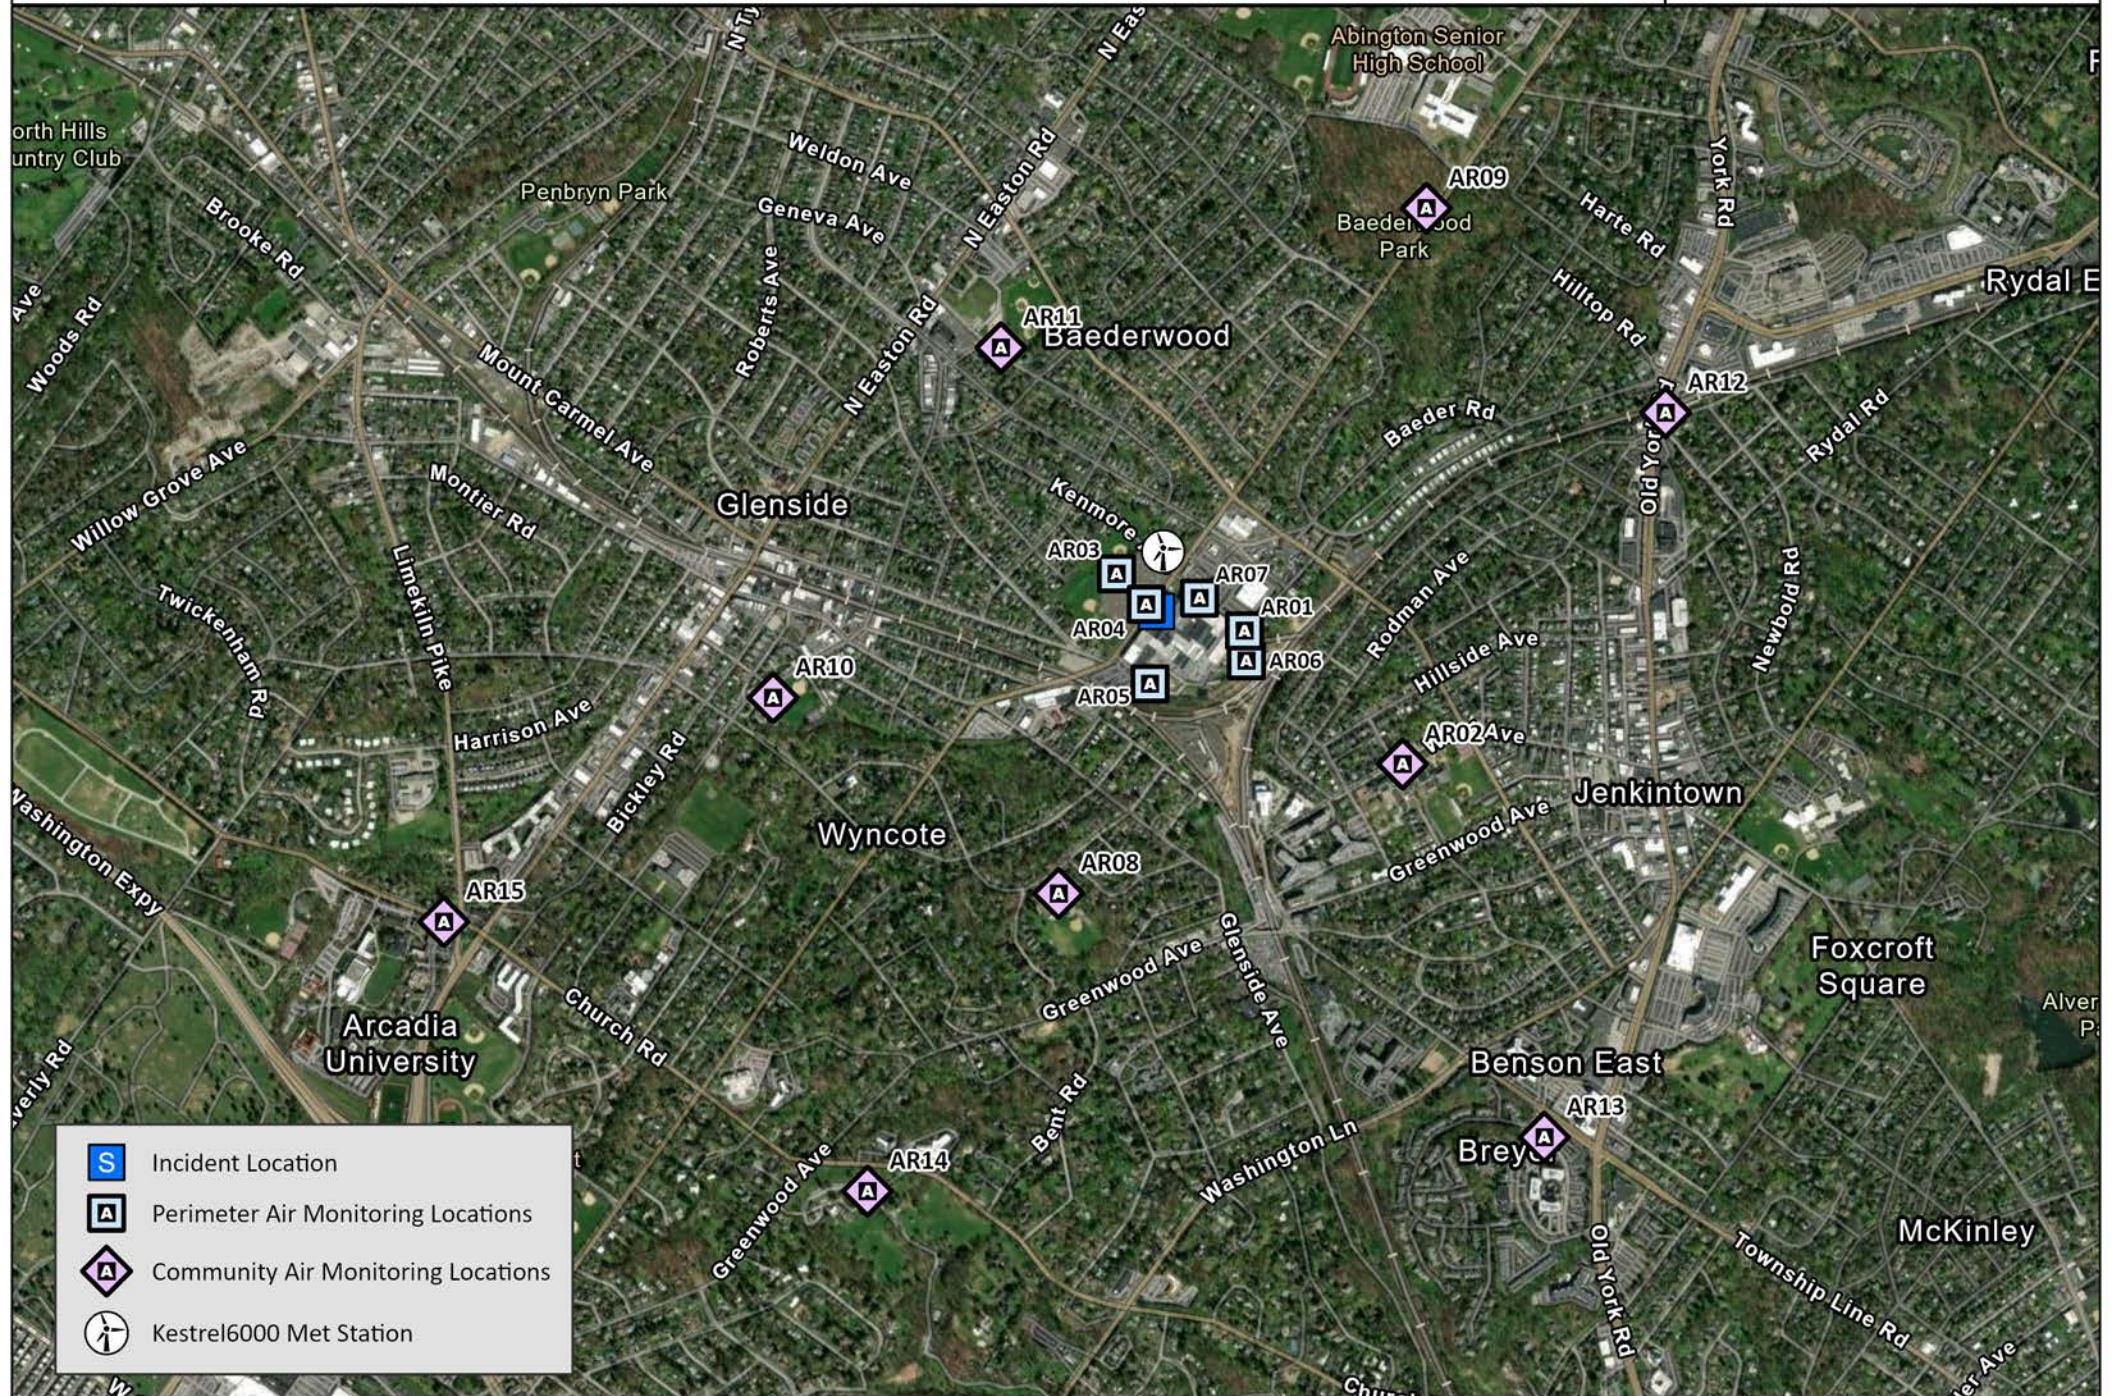 Incident Site

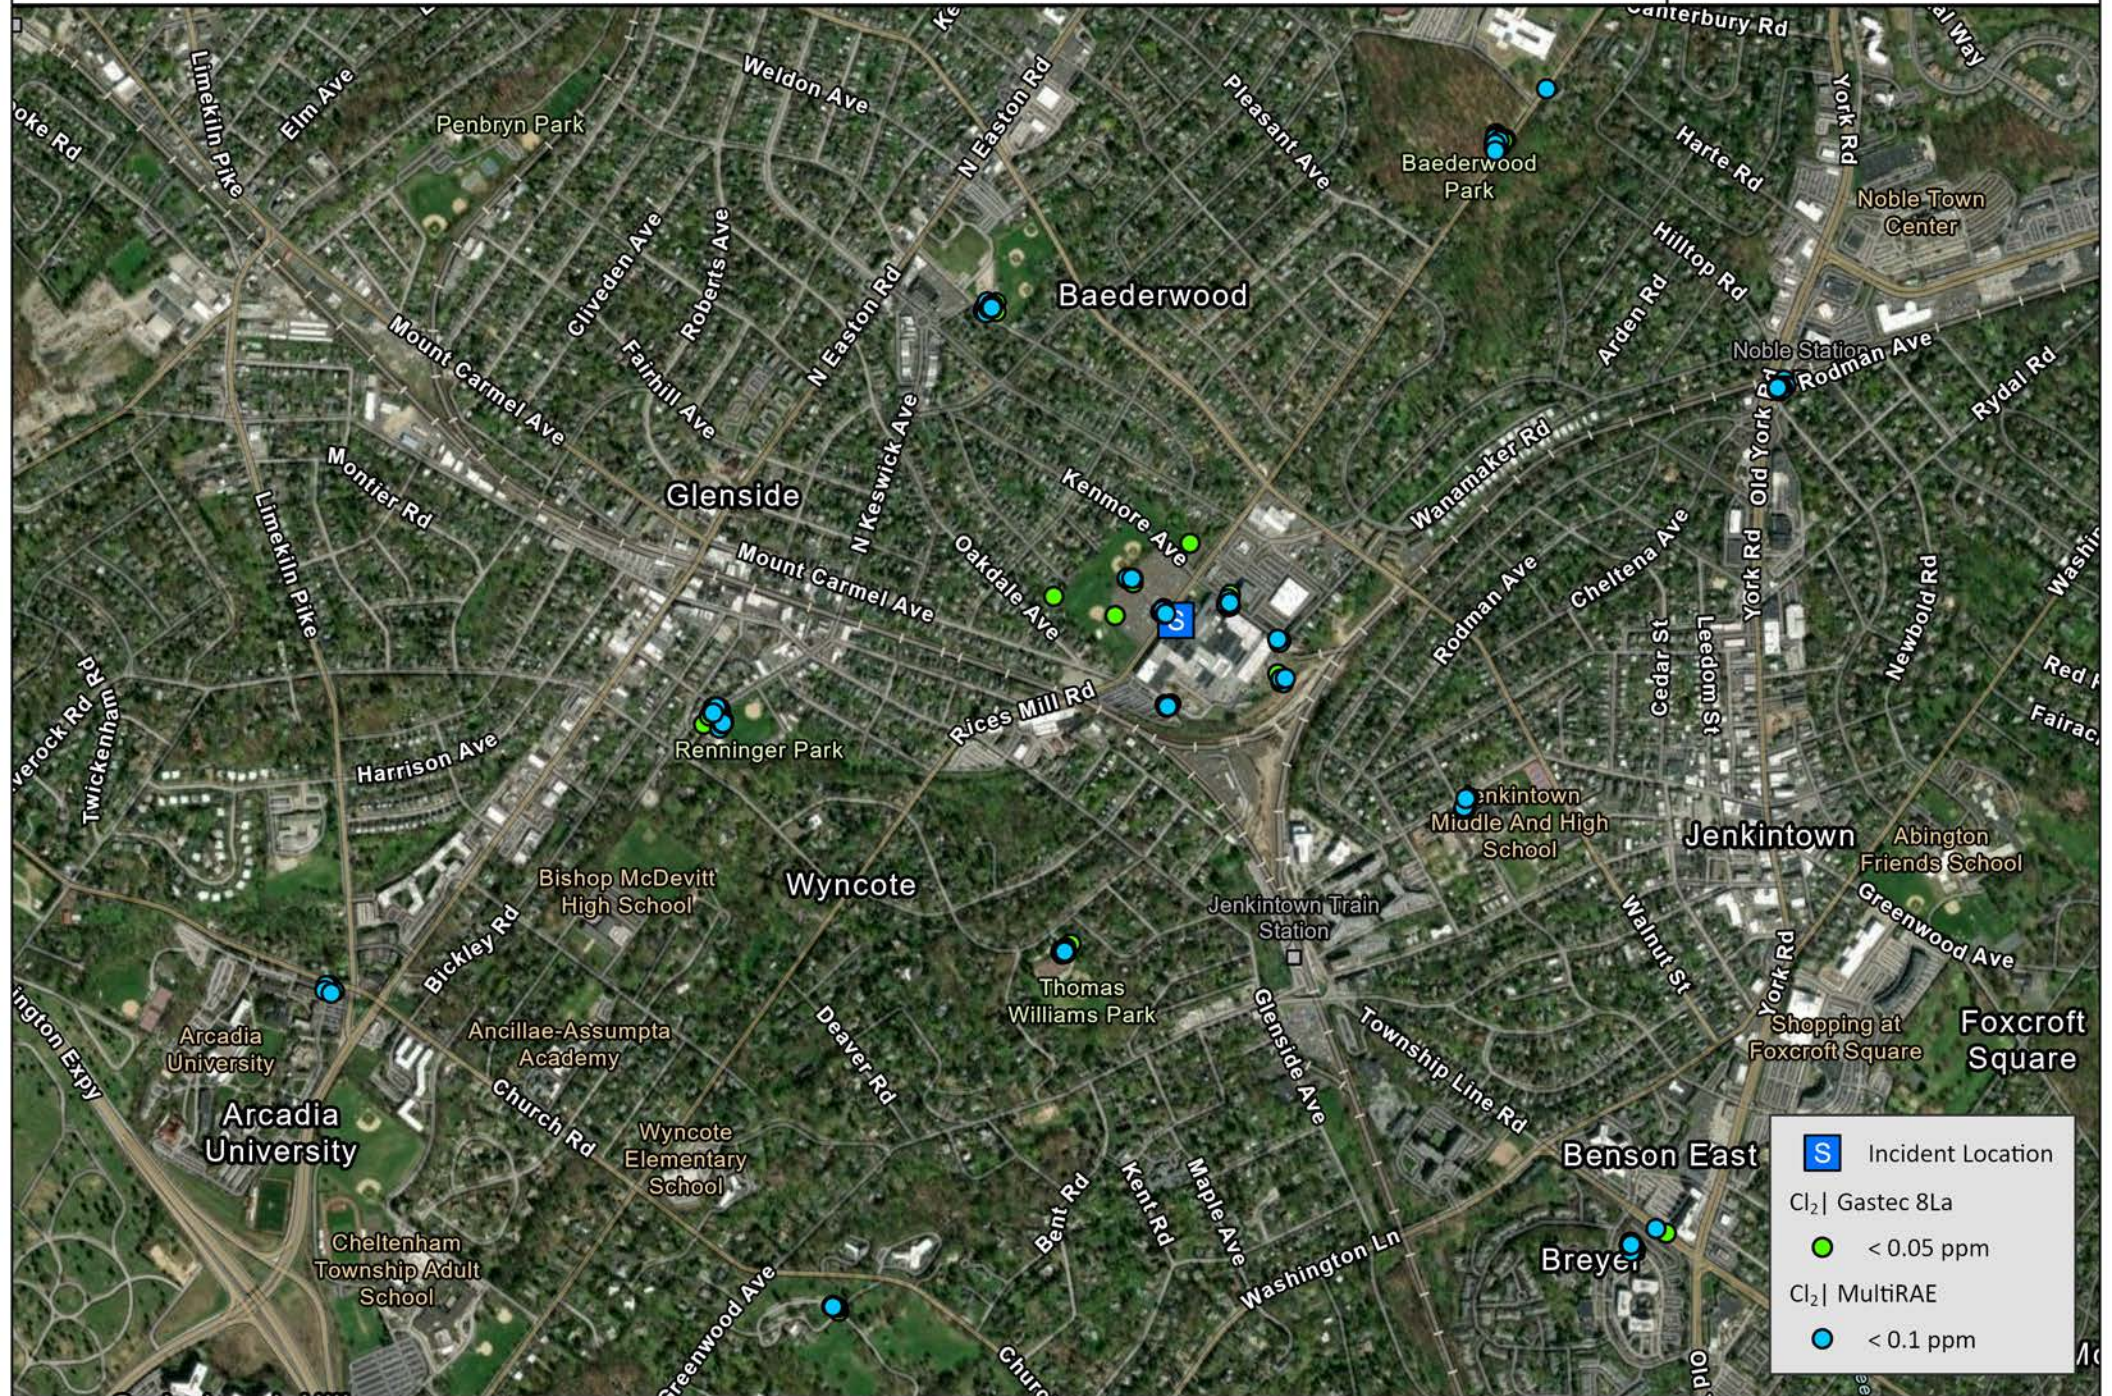


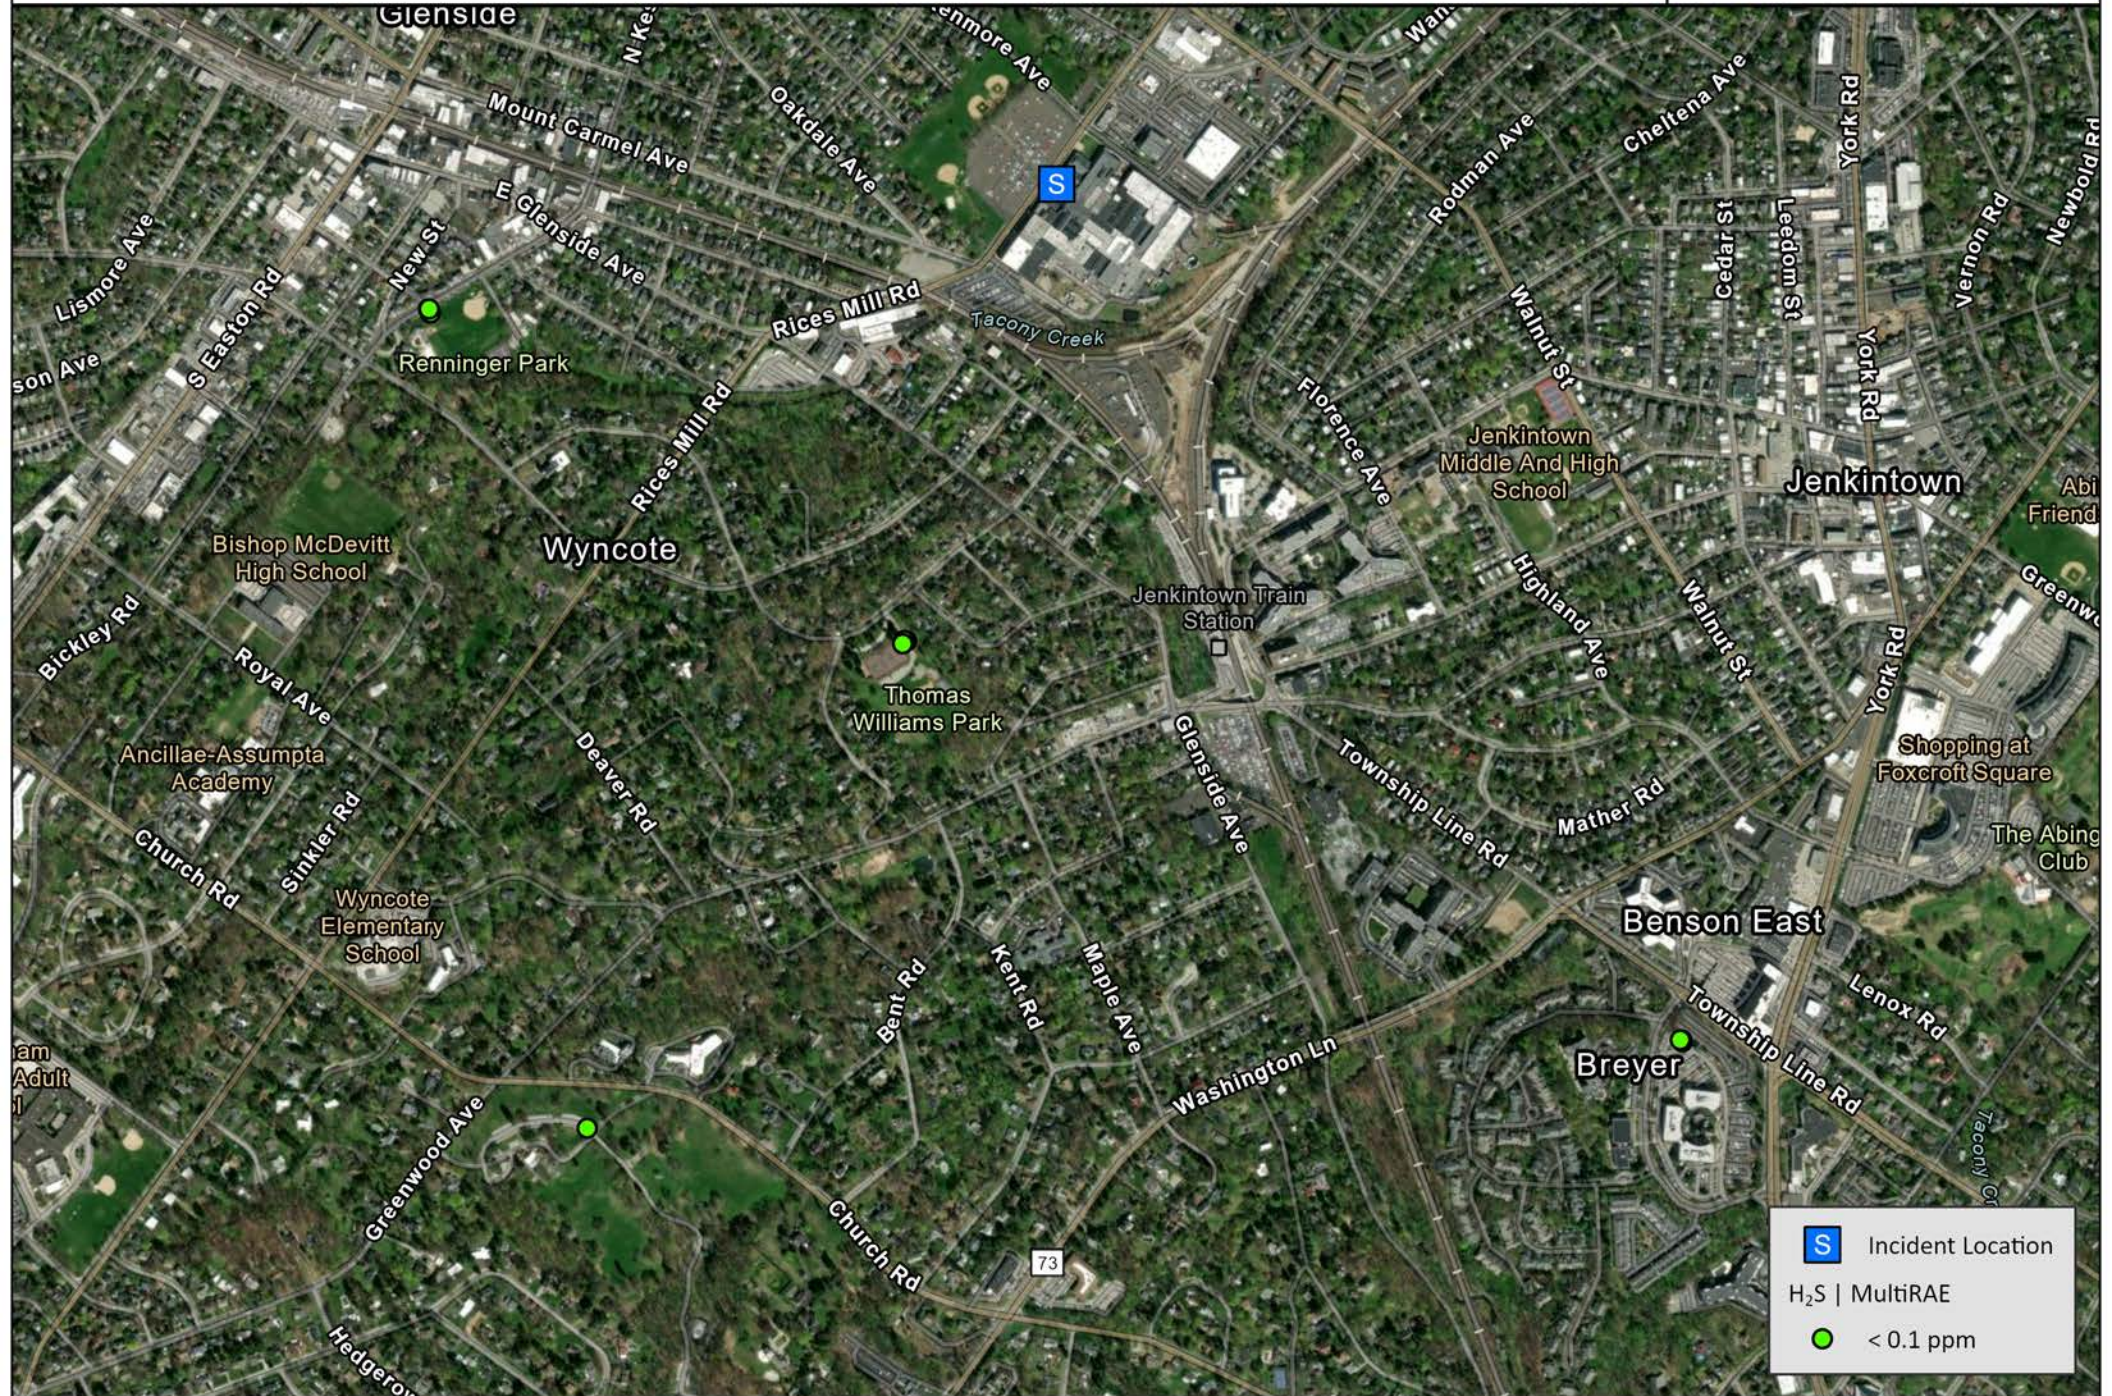


	Incident Location
	Cl ₂ Gastec 8La < 0.05 ppm
	Cl ₂ MultiRAE < 0.1 ppm



 Incident Location
H₂S | MultiRAE
 < 0.1 ppm

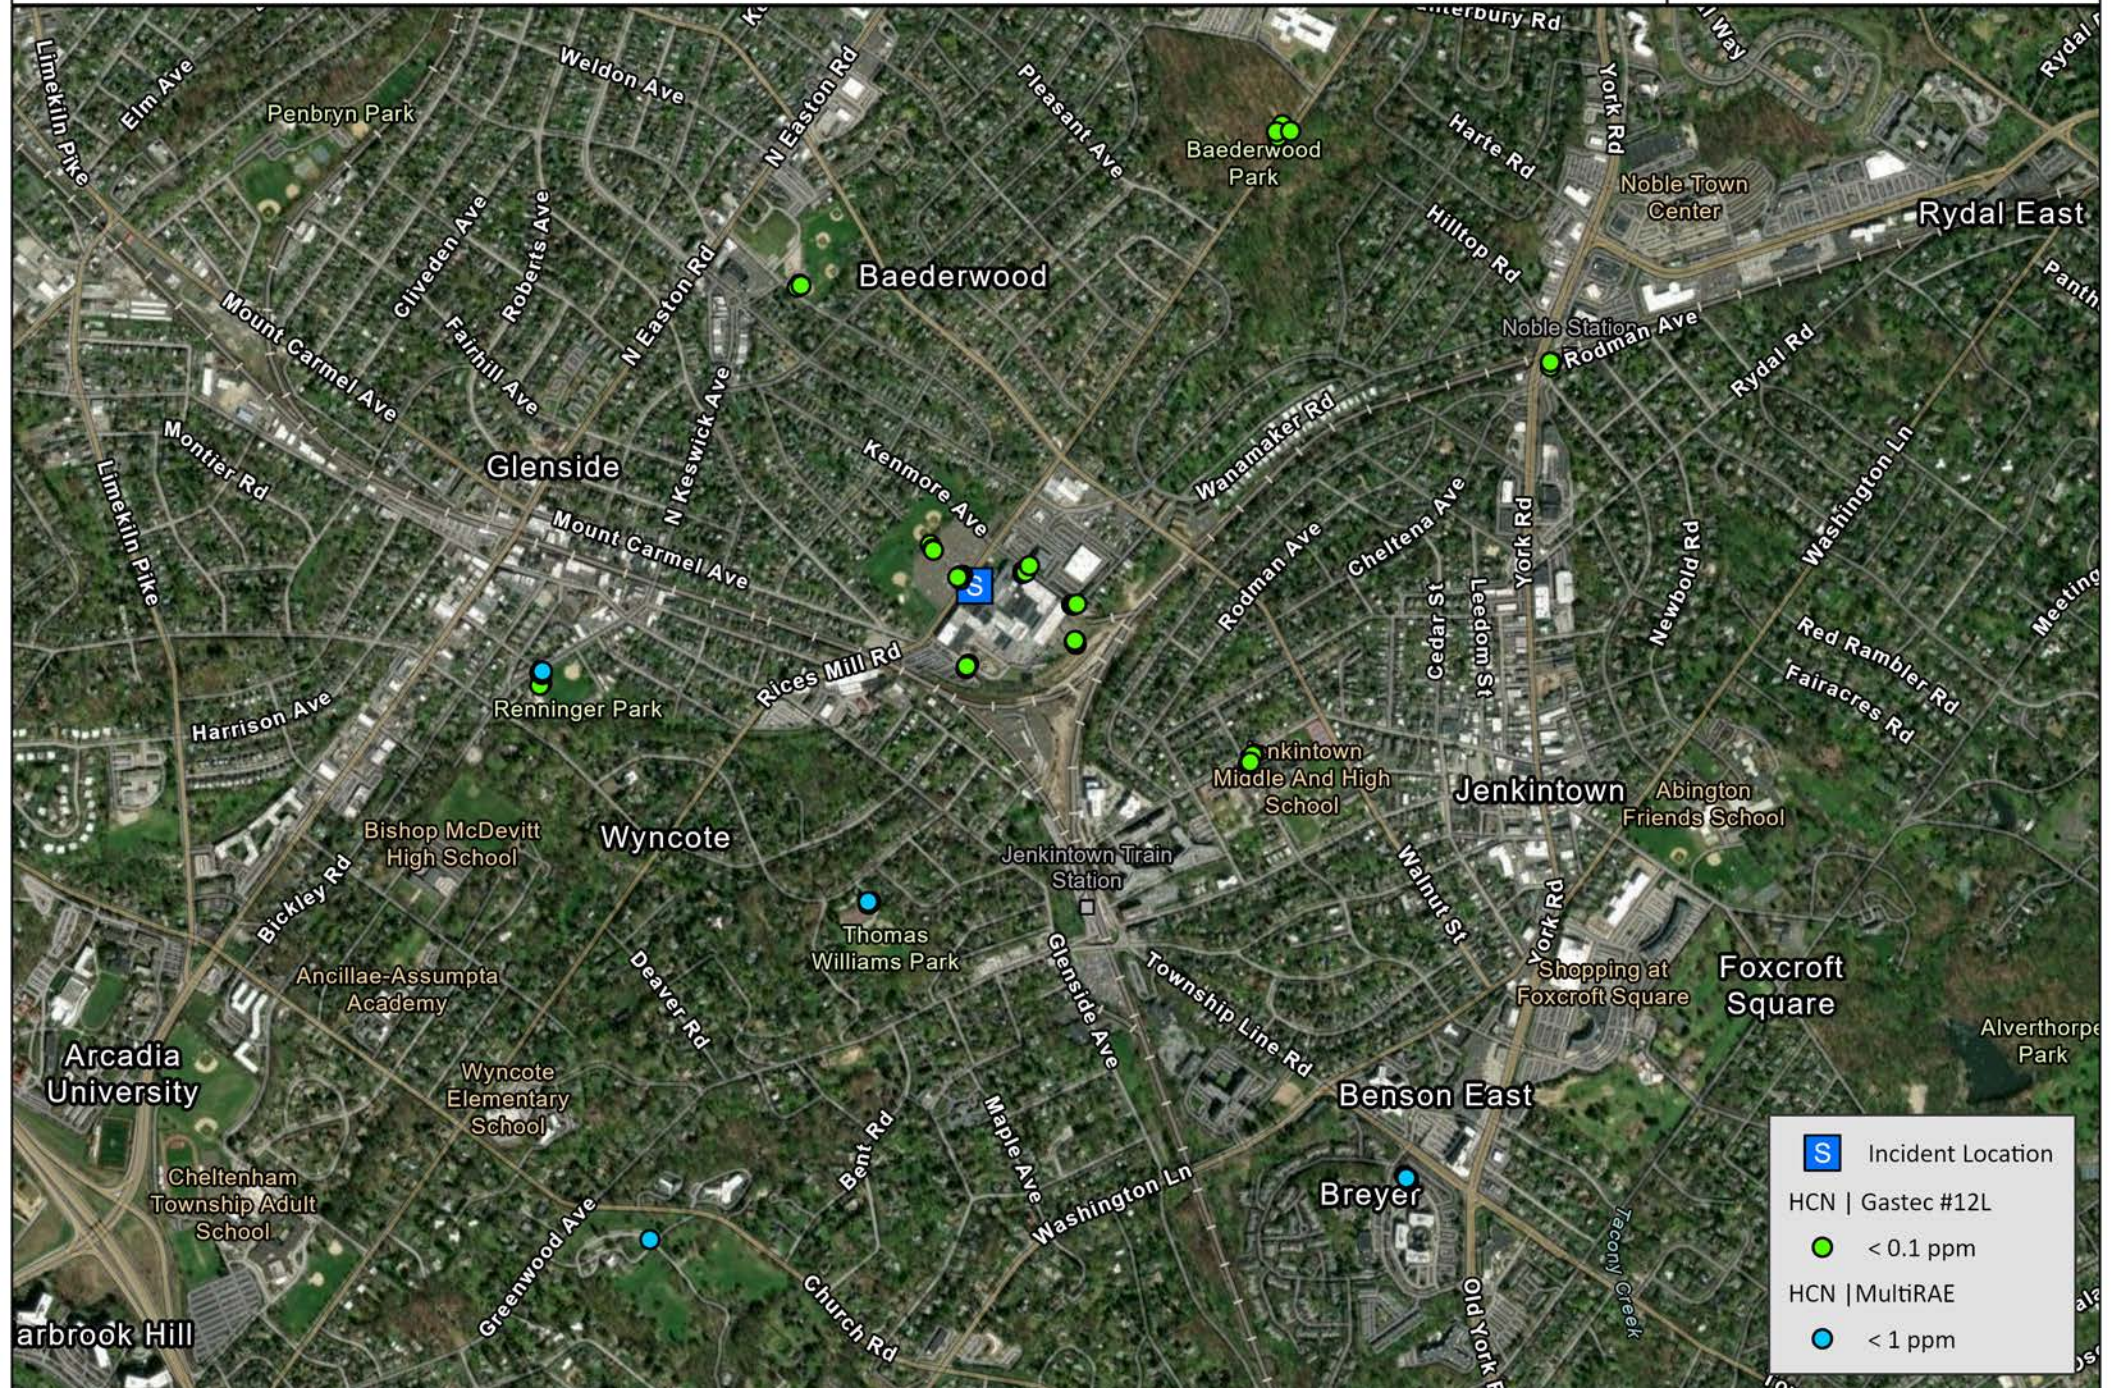

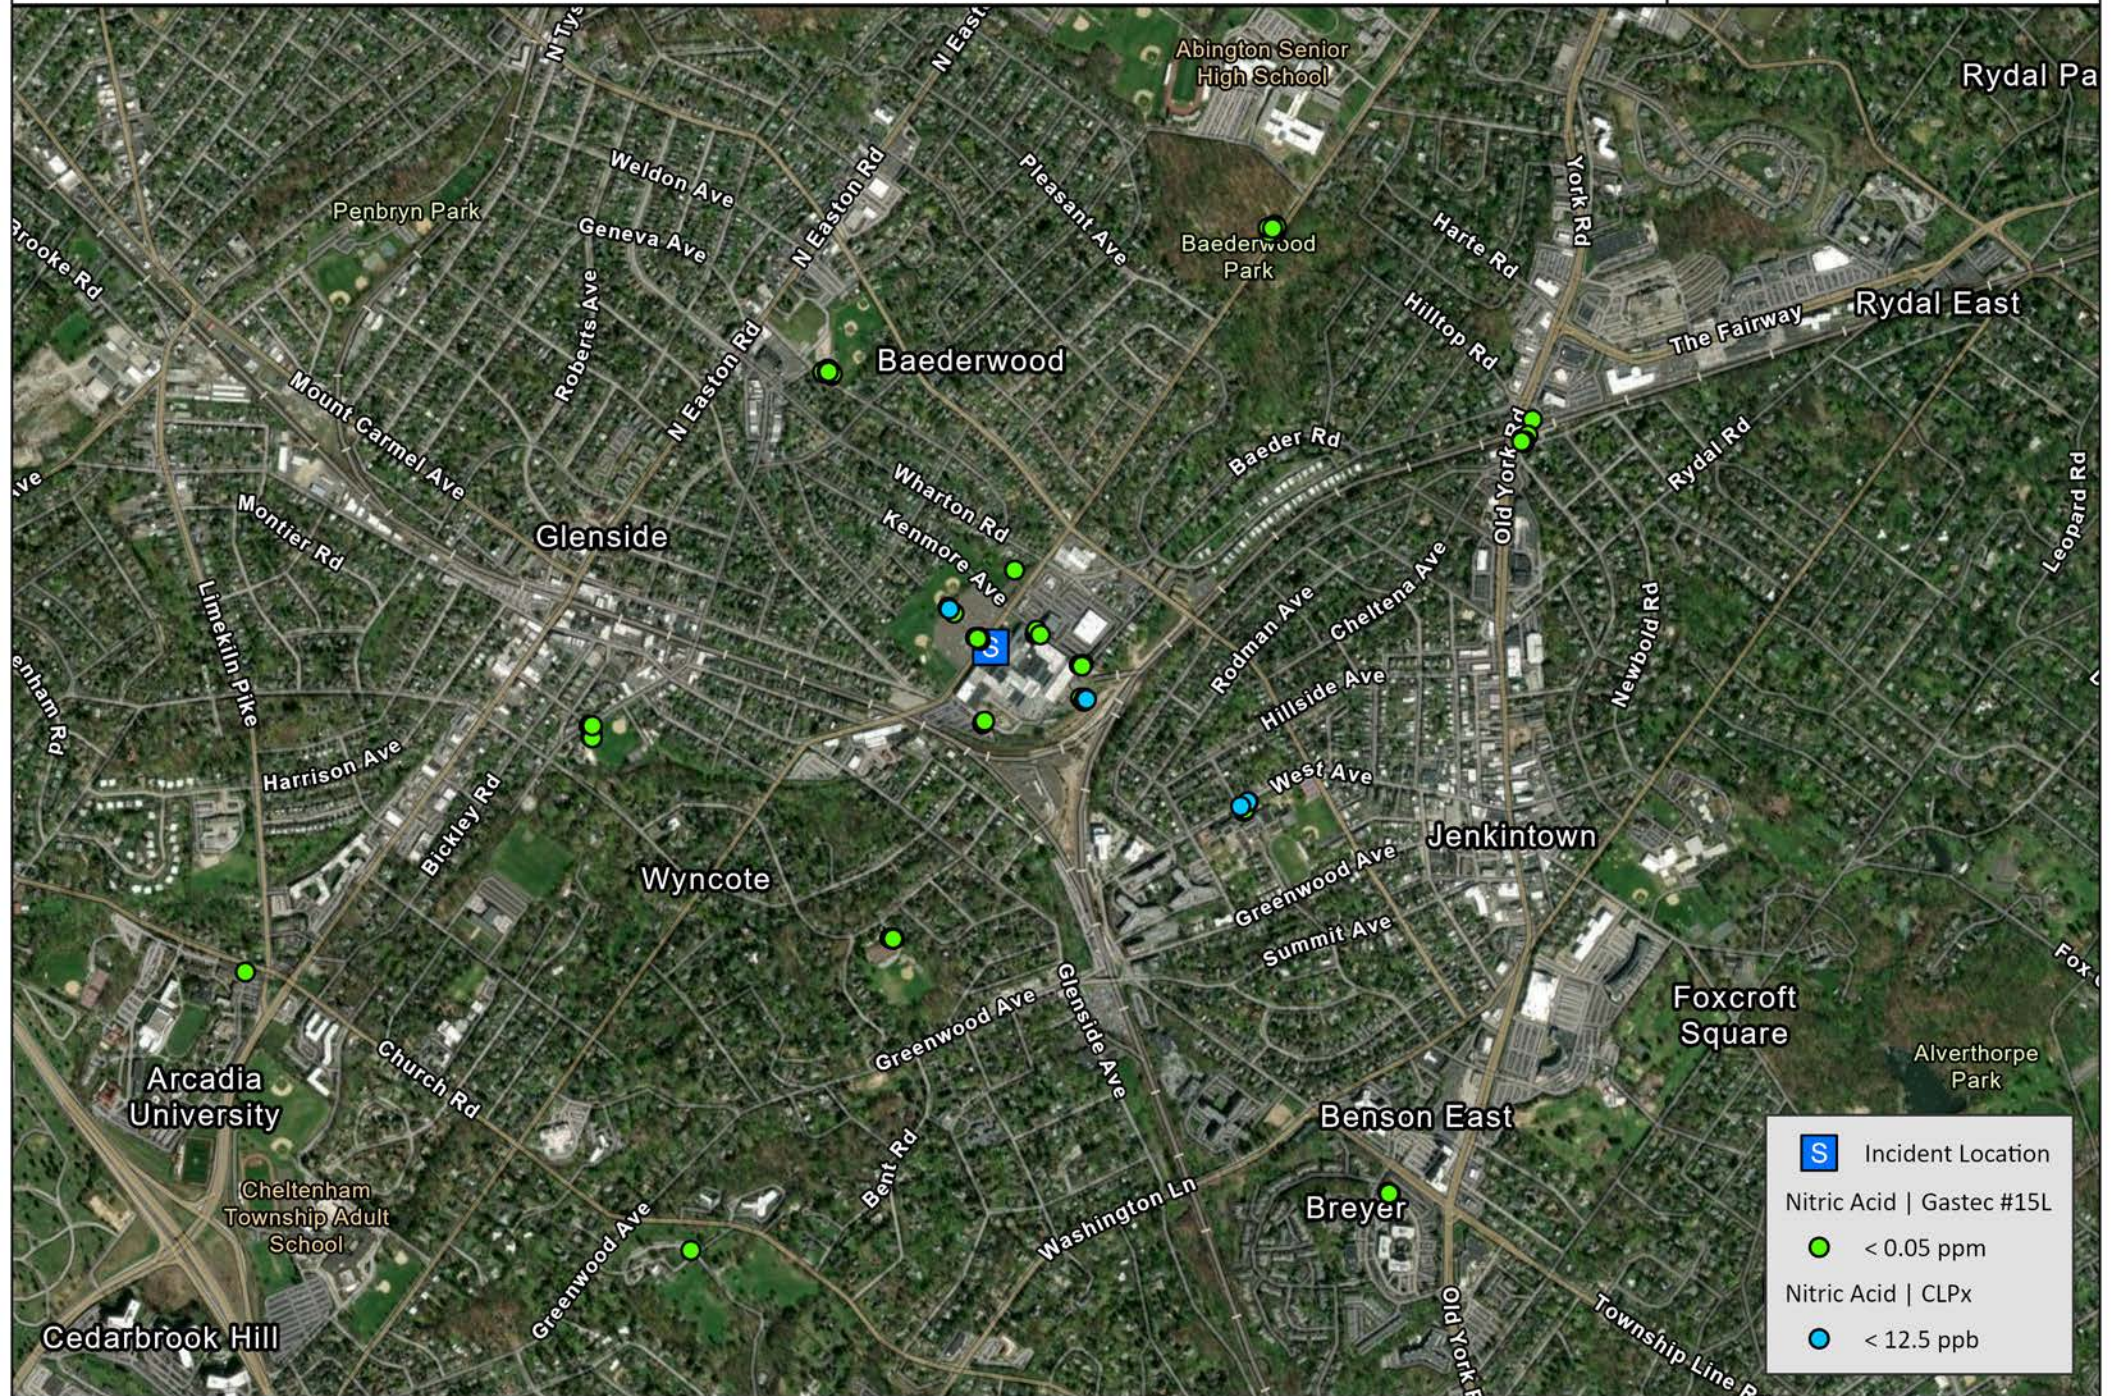


S Incident Location


Nitric Acid | Gastec #15L

● < 0.05 ppm

Nitric Acid | CLPx

● < 12.5 ppb

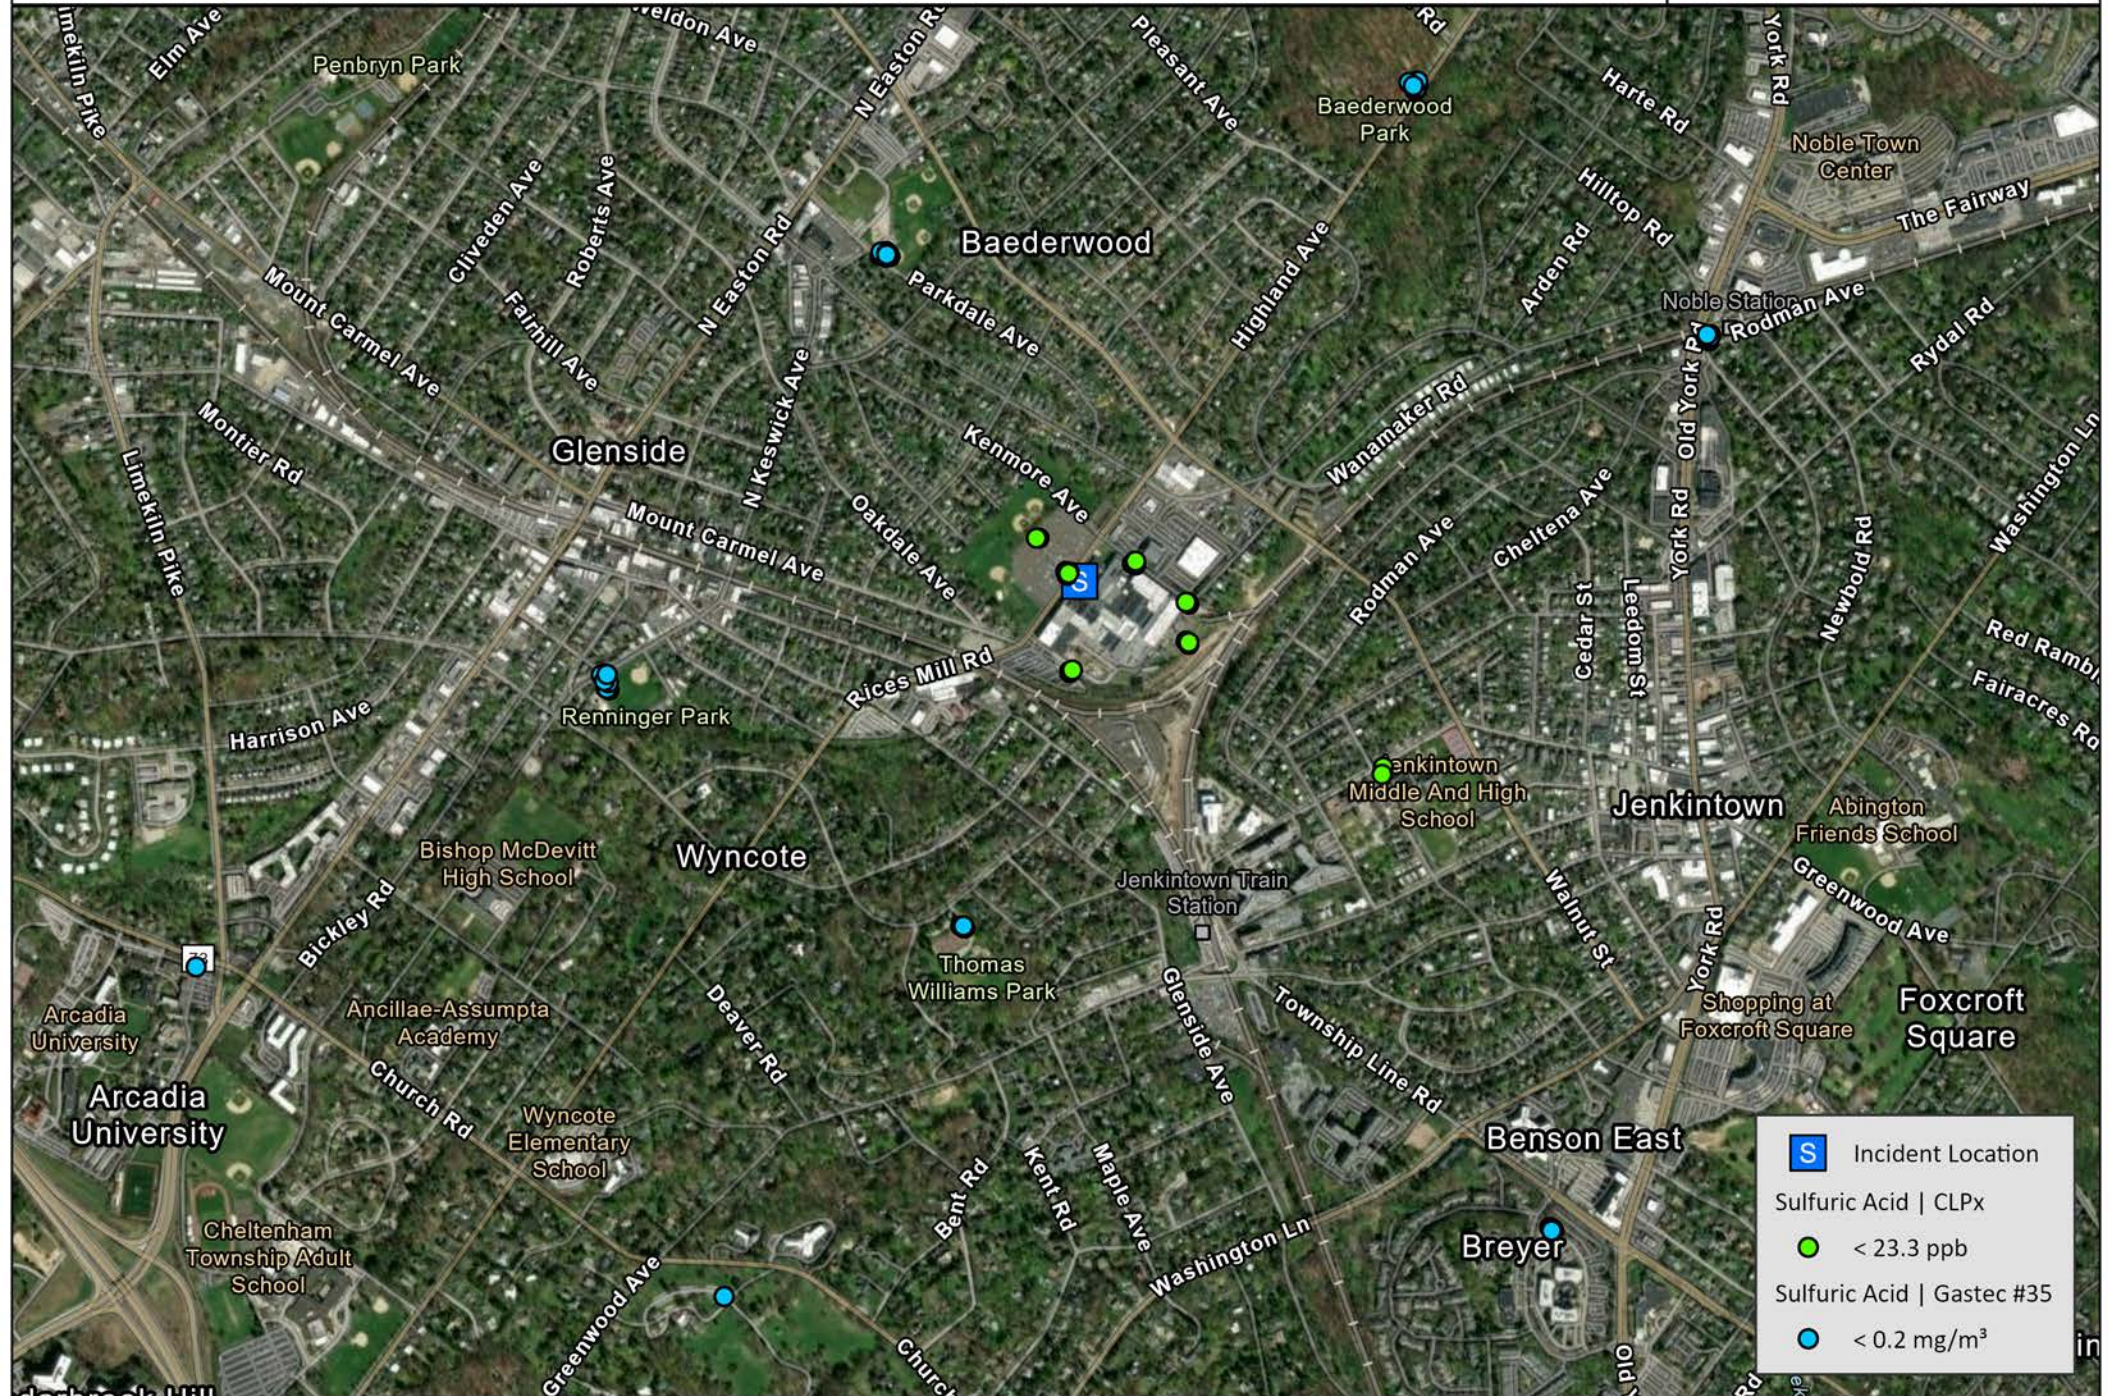

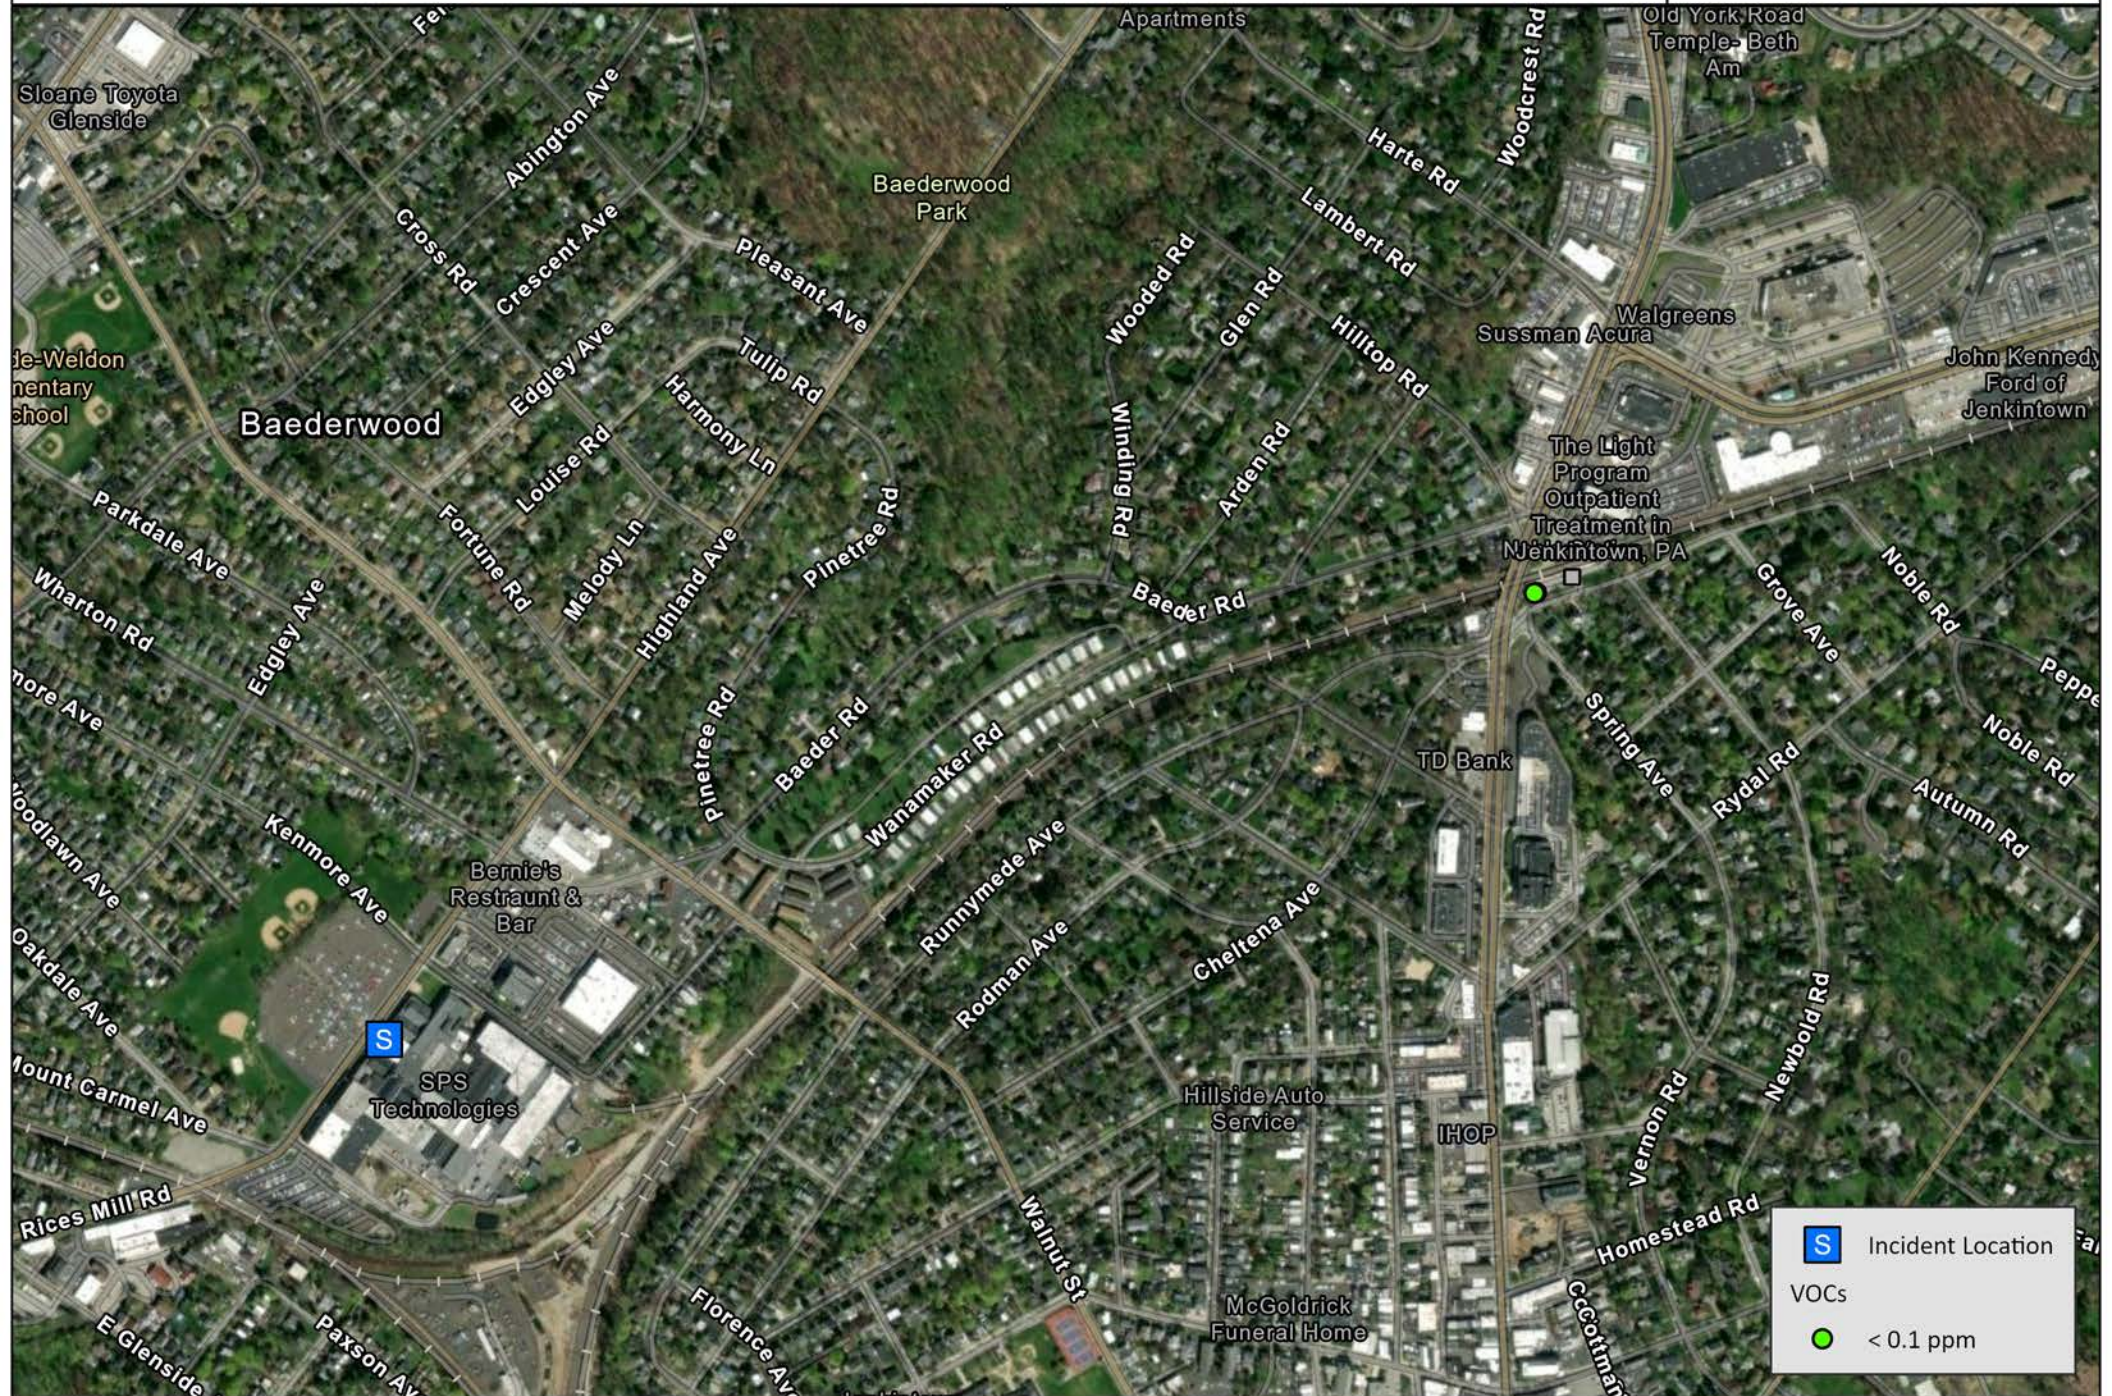

SPS Technologies

Incident Location

VOCs

< 0.1 ppm




Attachment B

Stationary Real-Time Perimeter Monitoring Graphs

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | SPS Technologies Fire | Abington Township, PA

2/24/2025 4:00:03 AM to 2/25/2025 4:40:54 AM | **Analyte: CO (ppm)**

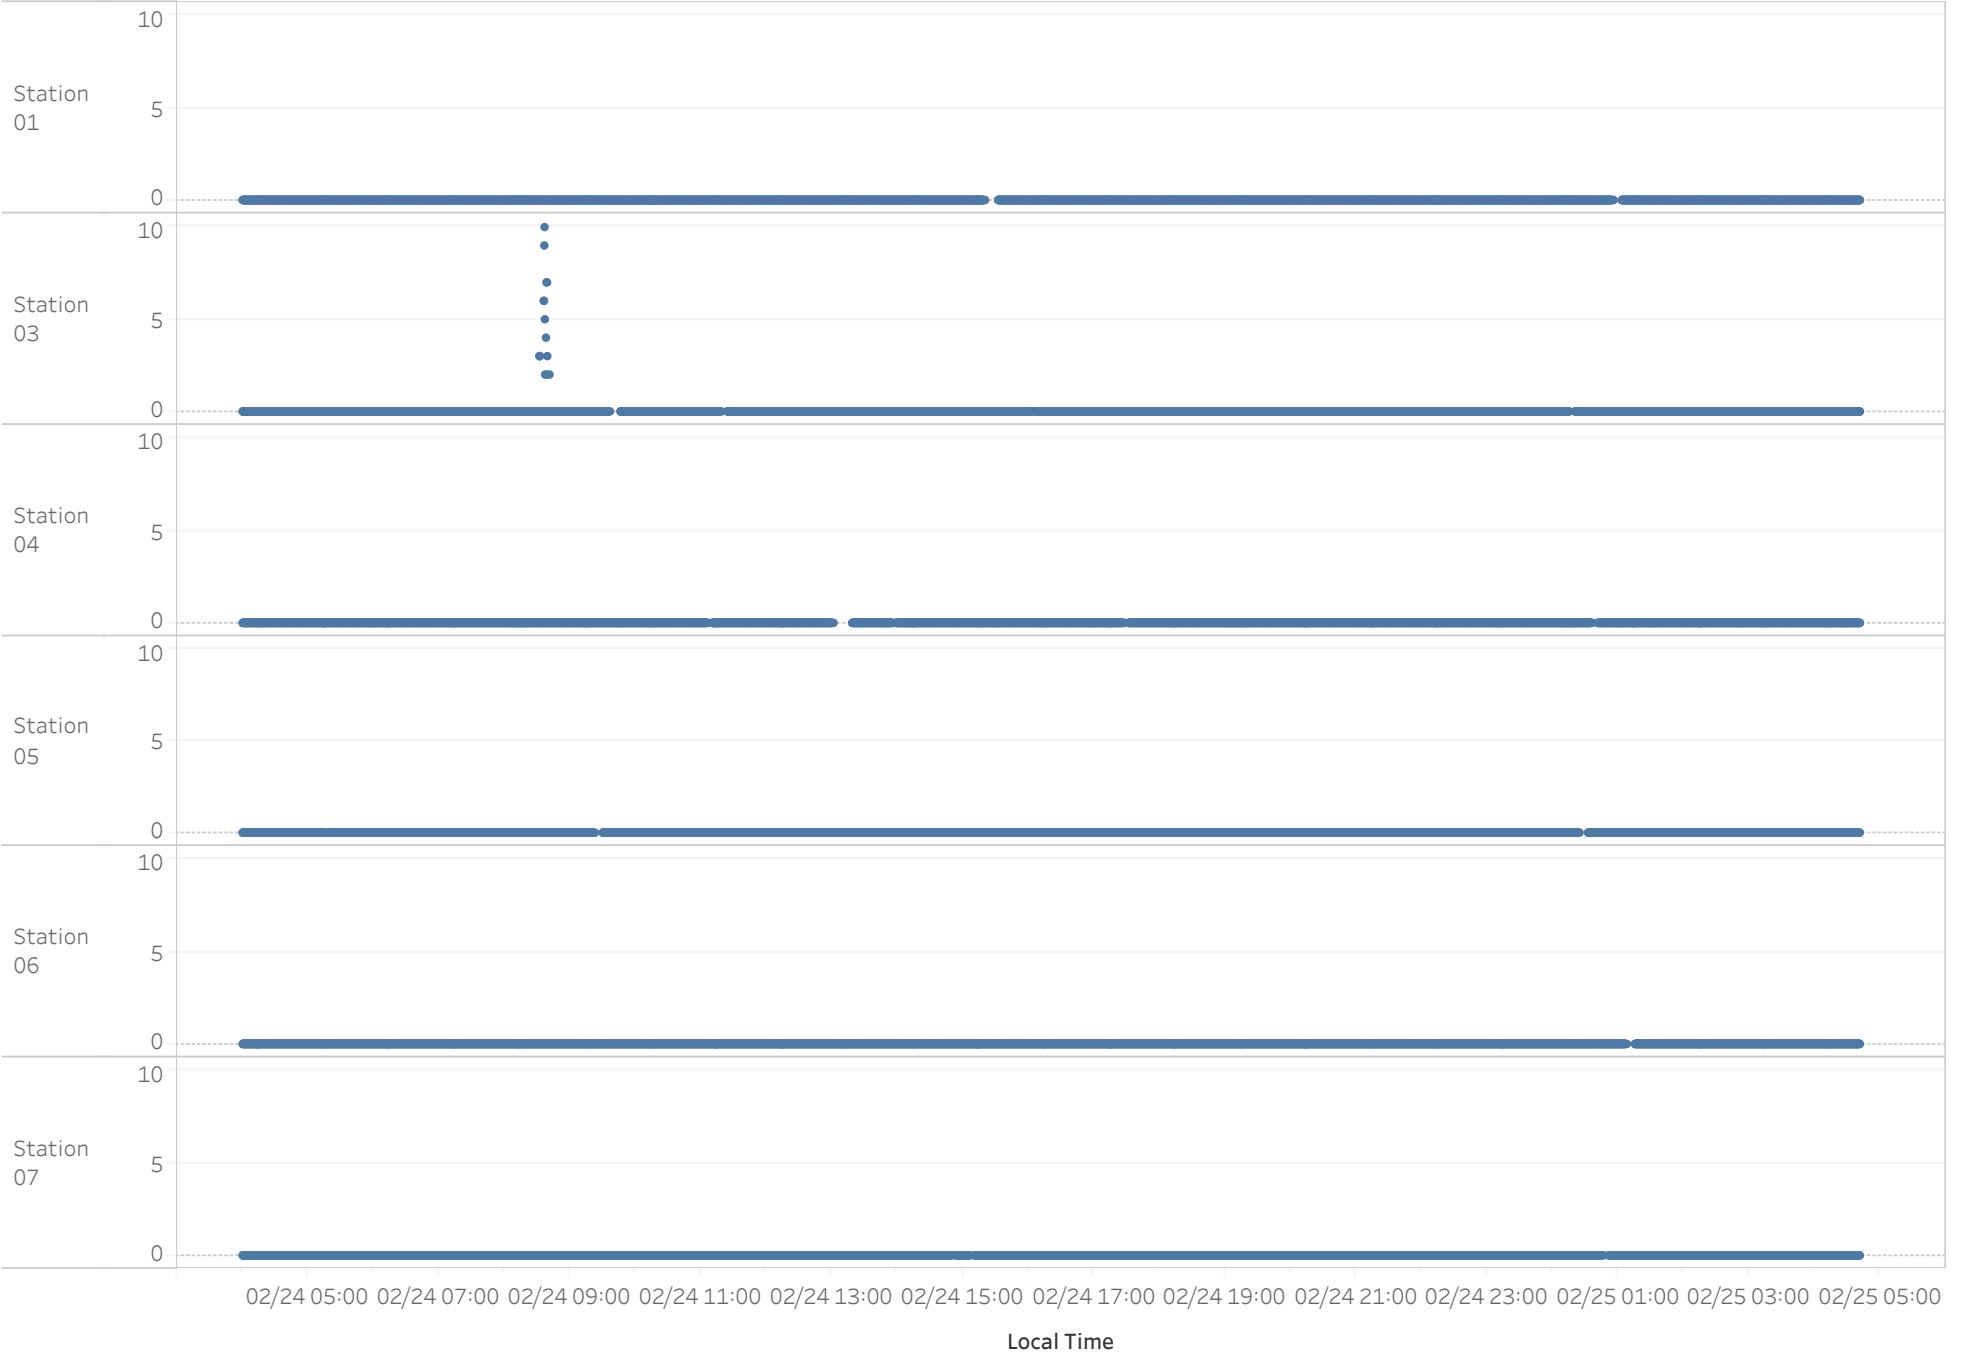

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | SPS Technologies Fire | Abington Township, PA


2/24/2025 4:00:03 AM to 2/25/2025 4:40:54 AM | **Analyte: H2S (ppm)**



Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | SPS Technologies Fire | Abington Township, PA

2/24/2025 4:00:03 AM to 2/25/2025 4:40:54 AM | Analyte: HCN (ppm)

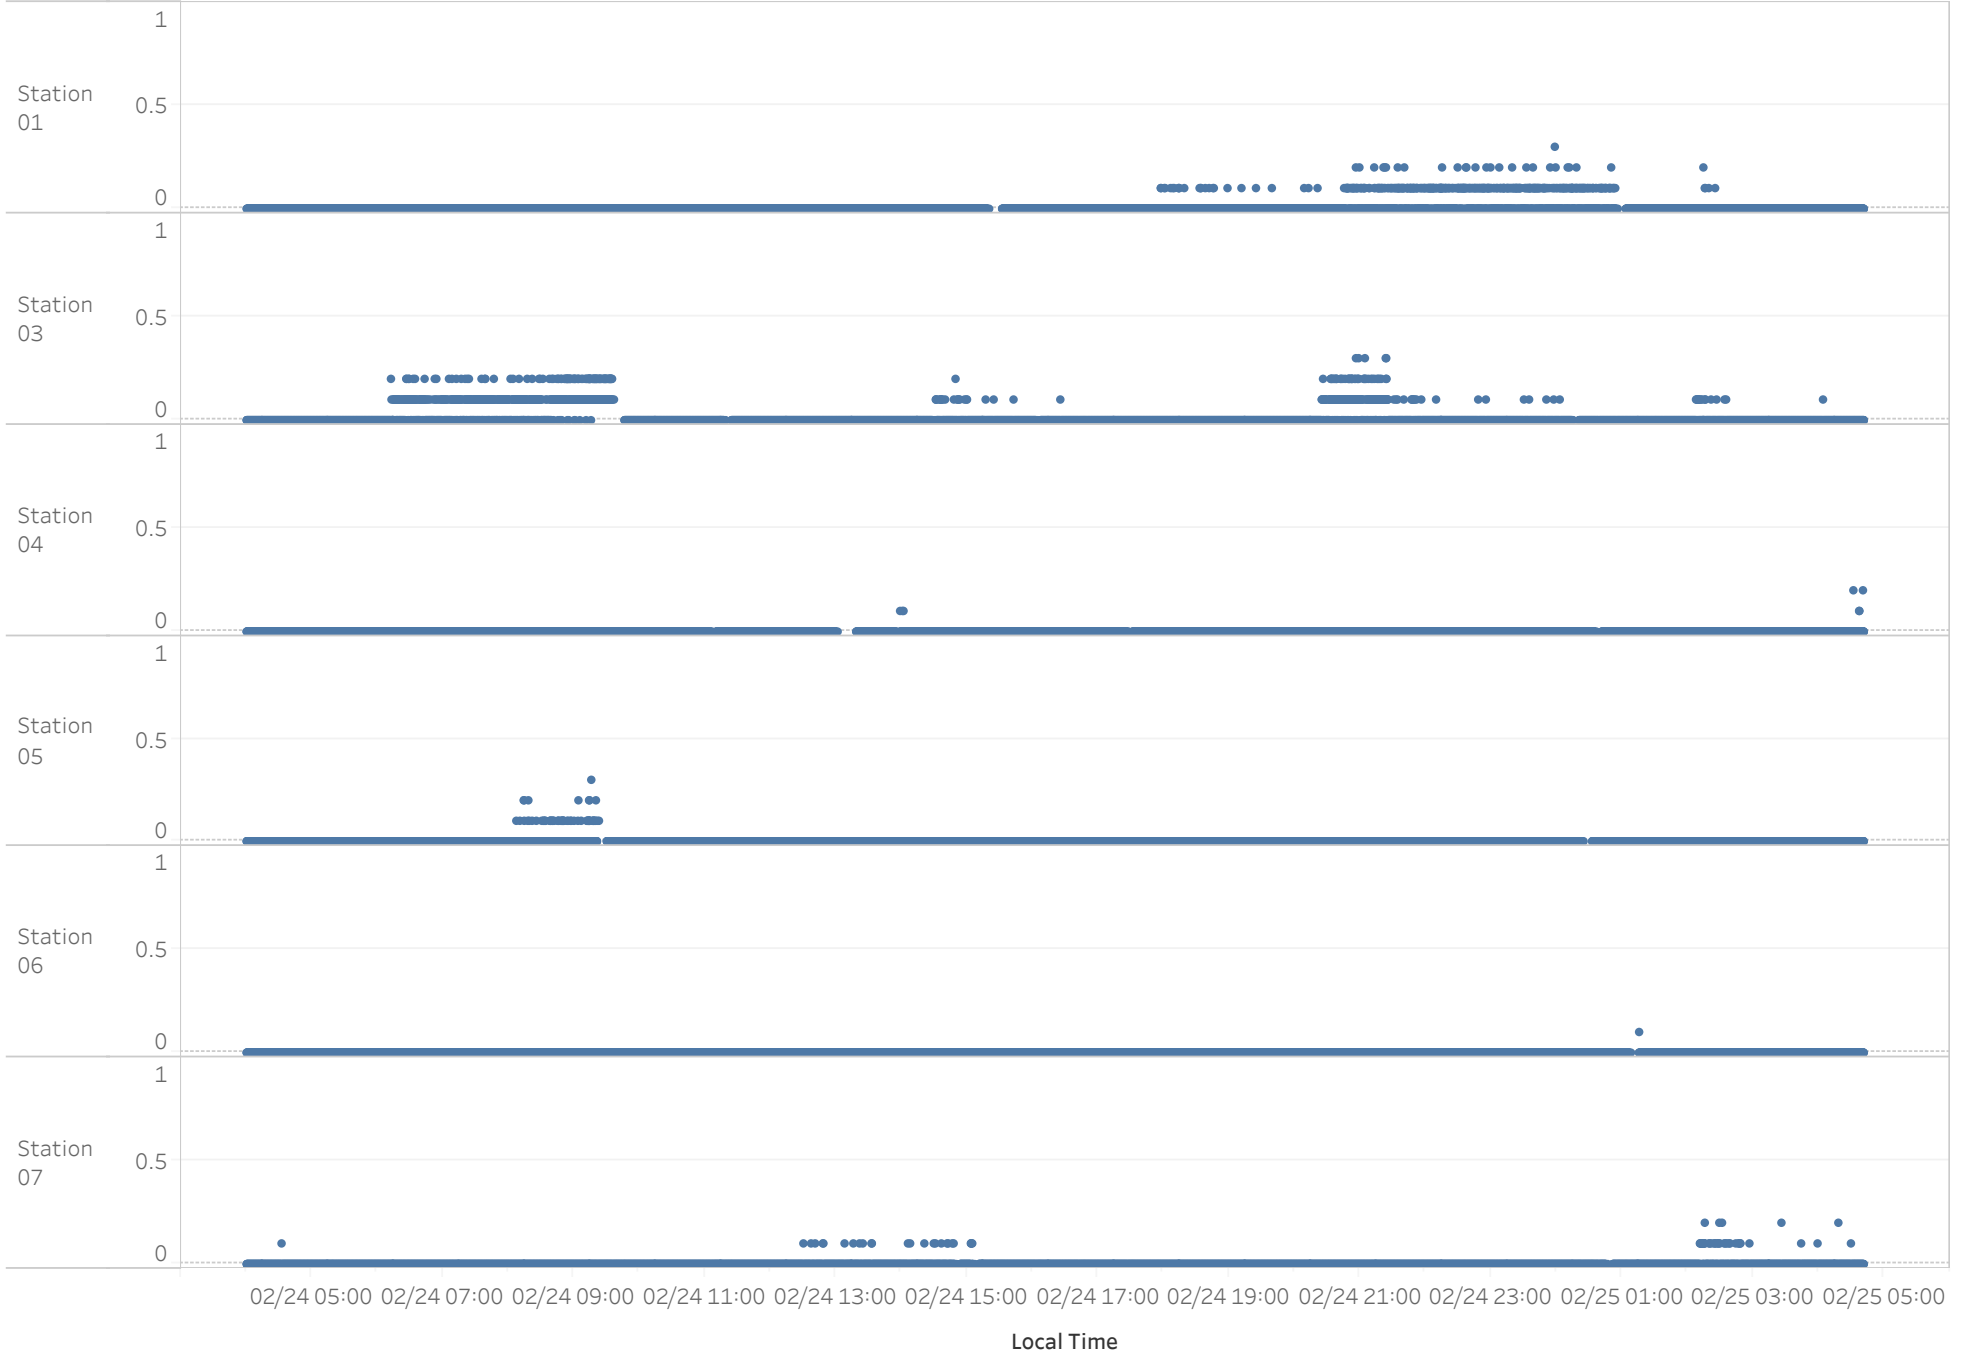

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | SPS Technologies Fire | Abington Township, PA


2/24/2025 4:00:03 AM to 2/25/2025 4:40:54 AM | **Analyte: LEL (%)**



Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | SPS Technologies Fire | Abington Township, PA


2/24/2025 4:00:03 AM to 2/25/2025 4:40:54 AM | **Analyte: VOCs (ppm)**

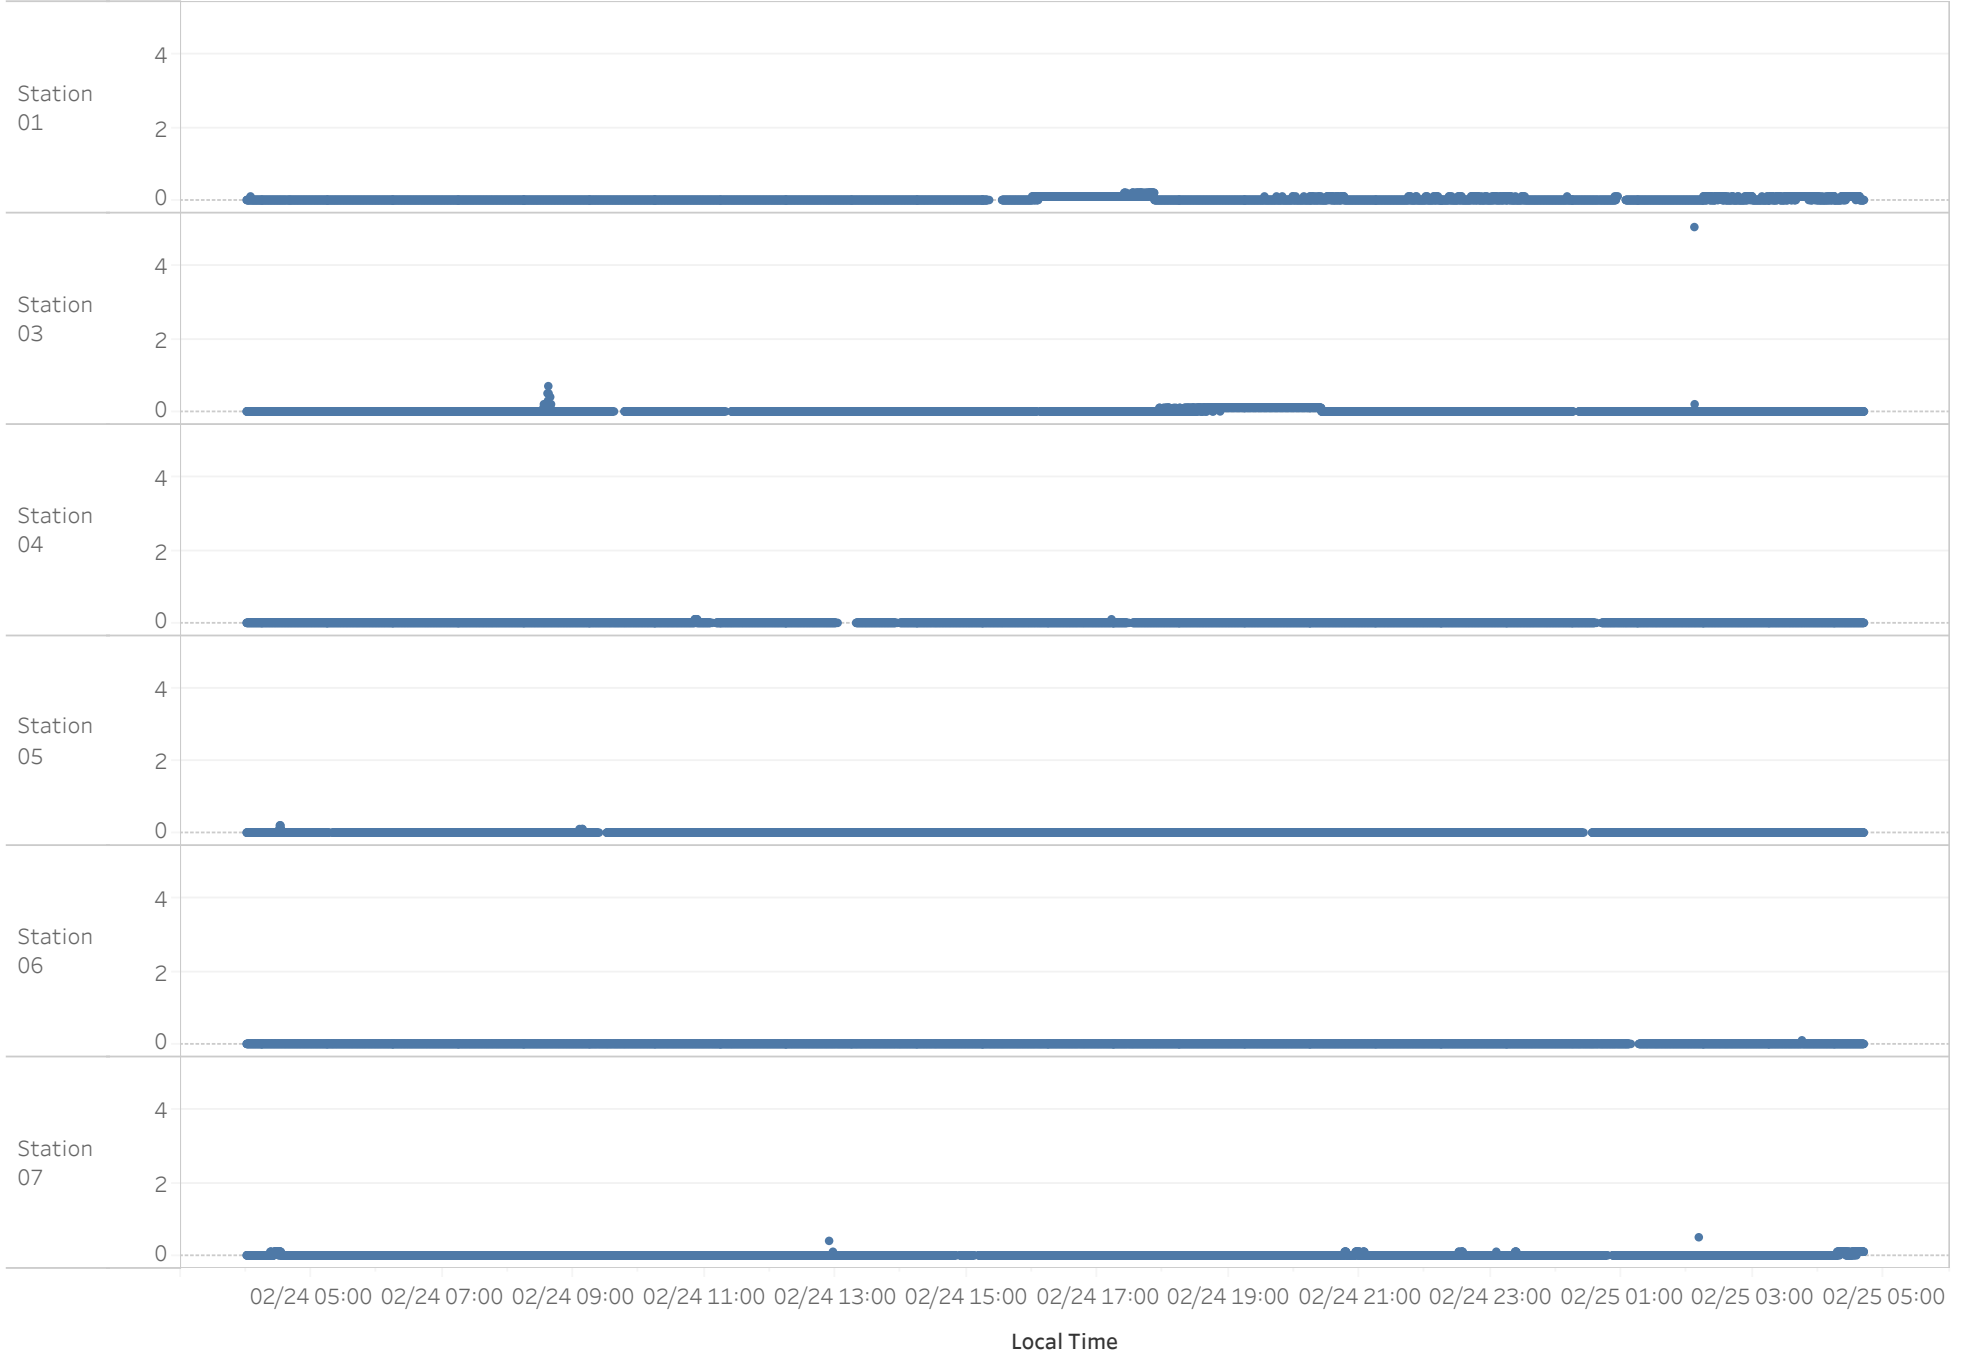

PROJ-052216 | PM2.5 Graph

SPS Technologies Fire | Abington Township, PA

02/24 06:00 to 02/25 04:59

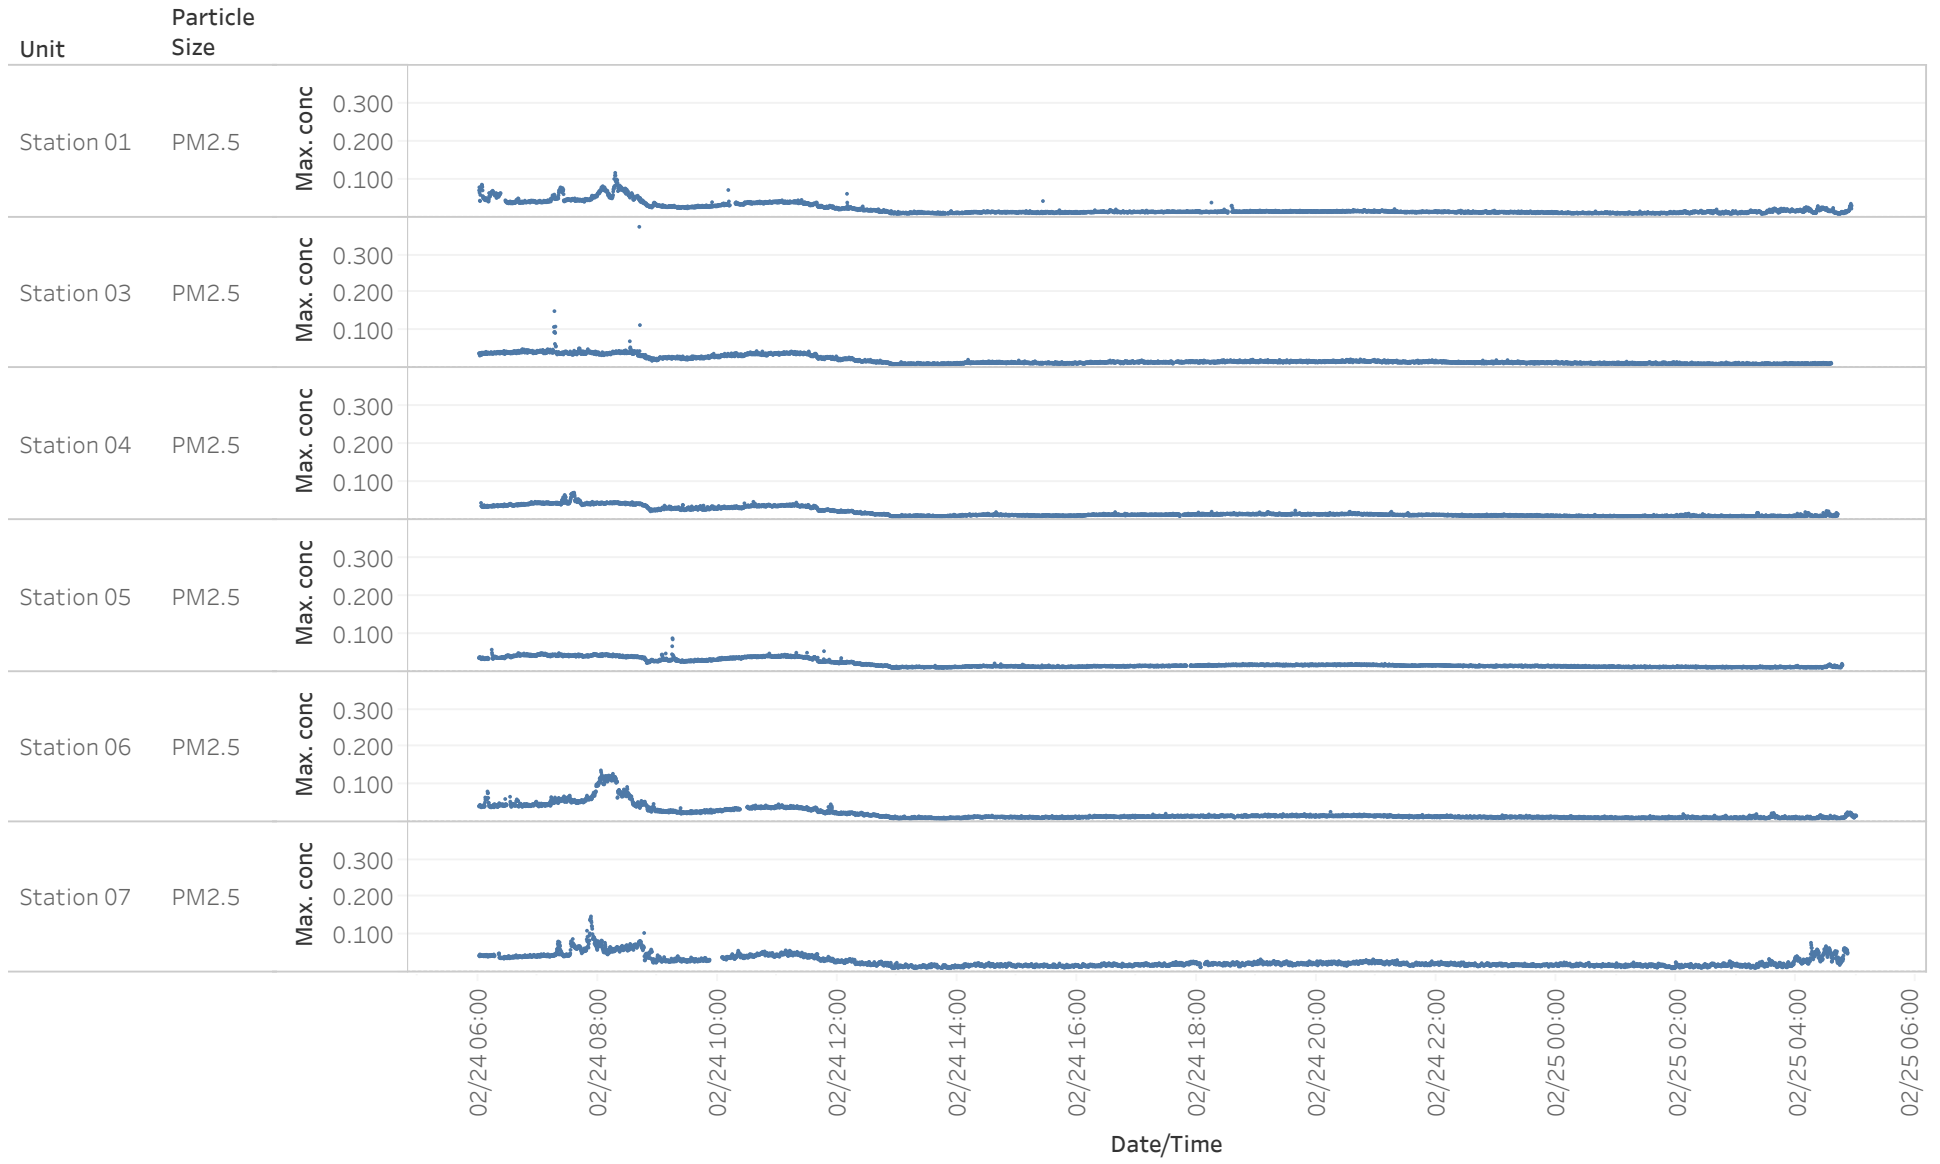

PROJ-052216 Summary Table | PM2.5

Unit	Particle Size	Count of Records	Count of Detections	Min. concentration	Max. concentration	Avg. concentration
Station 01	PM2.5	5,439	5,439	0.010	0.118	0.023
Station 03	PM2.5	5,422	5,422	0.009	0.375	0.020
Station 04	PM2.5	5,424	5,424	0.009	0.072	0.020
Station 05	PM2.5	5,428	5,428	0.011	0.089	0.022
Station 06	PM2.5	5,469	5,469	0.009	0.138	0.023
Station 07	PM2.5	5,398	5,398	0.011	0.149	0.029


Attachment C

Stationary Real-Time Community Monitoring Graphs

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA


2/24/2025 6:00:03 AM to 2/25/2025 5:16:36 AM | Analyte: CO (ppm)

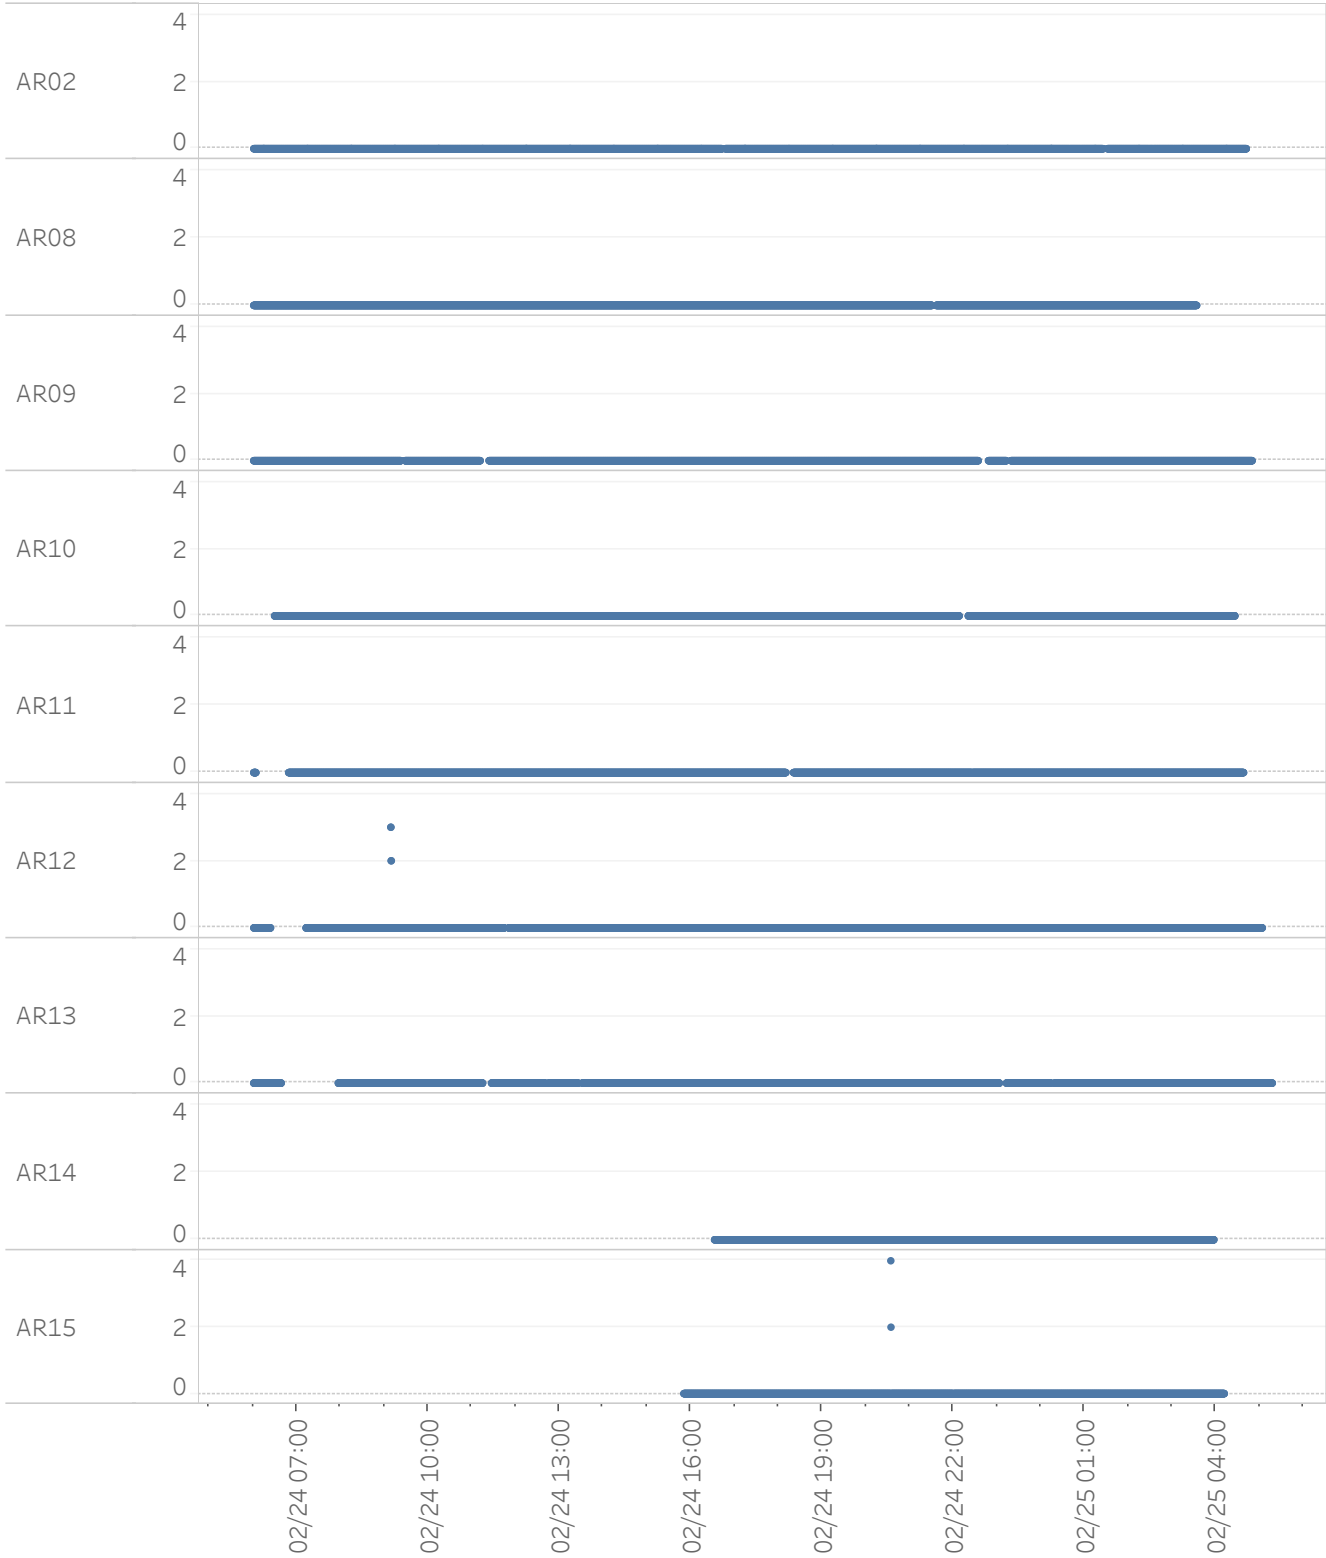

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA


2/24/2025 6:00:03 AM to 2/25/2025 5:16:36 AM | **Analyte: HCN (ppm)**

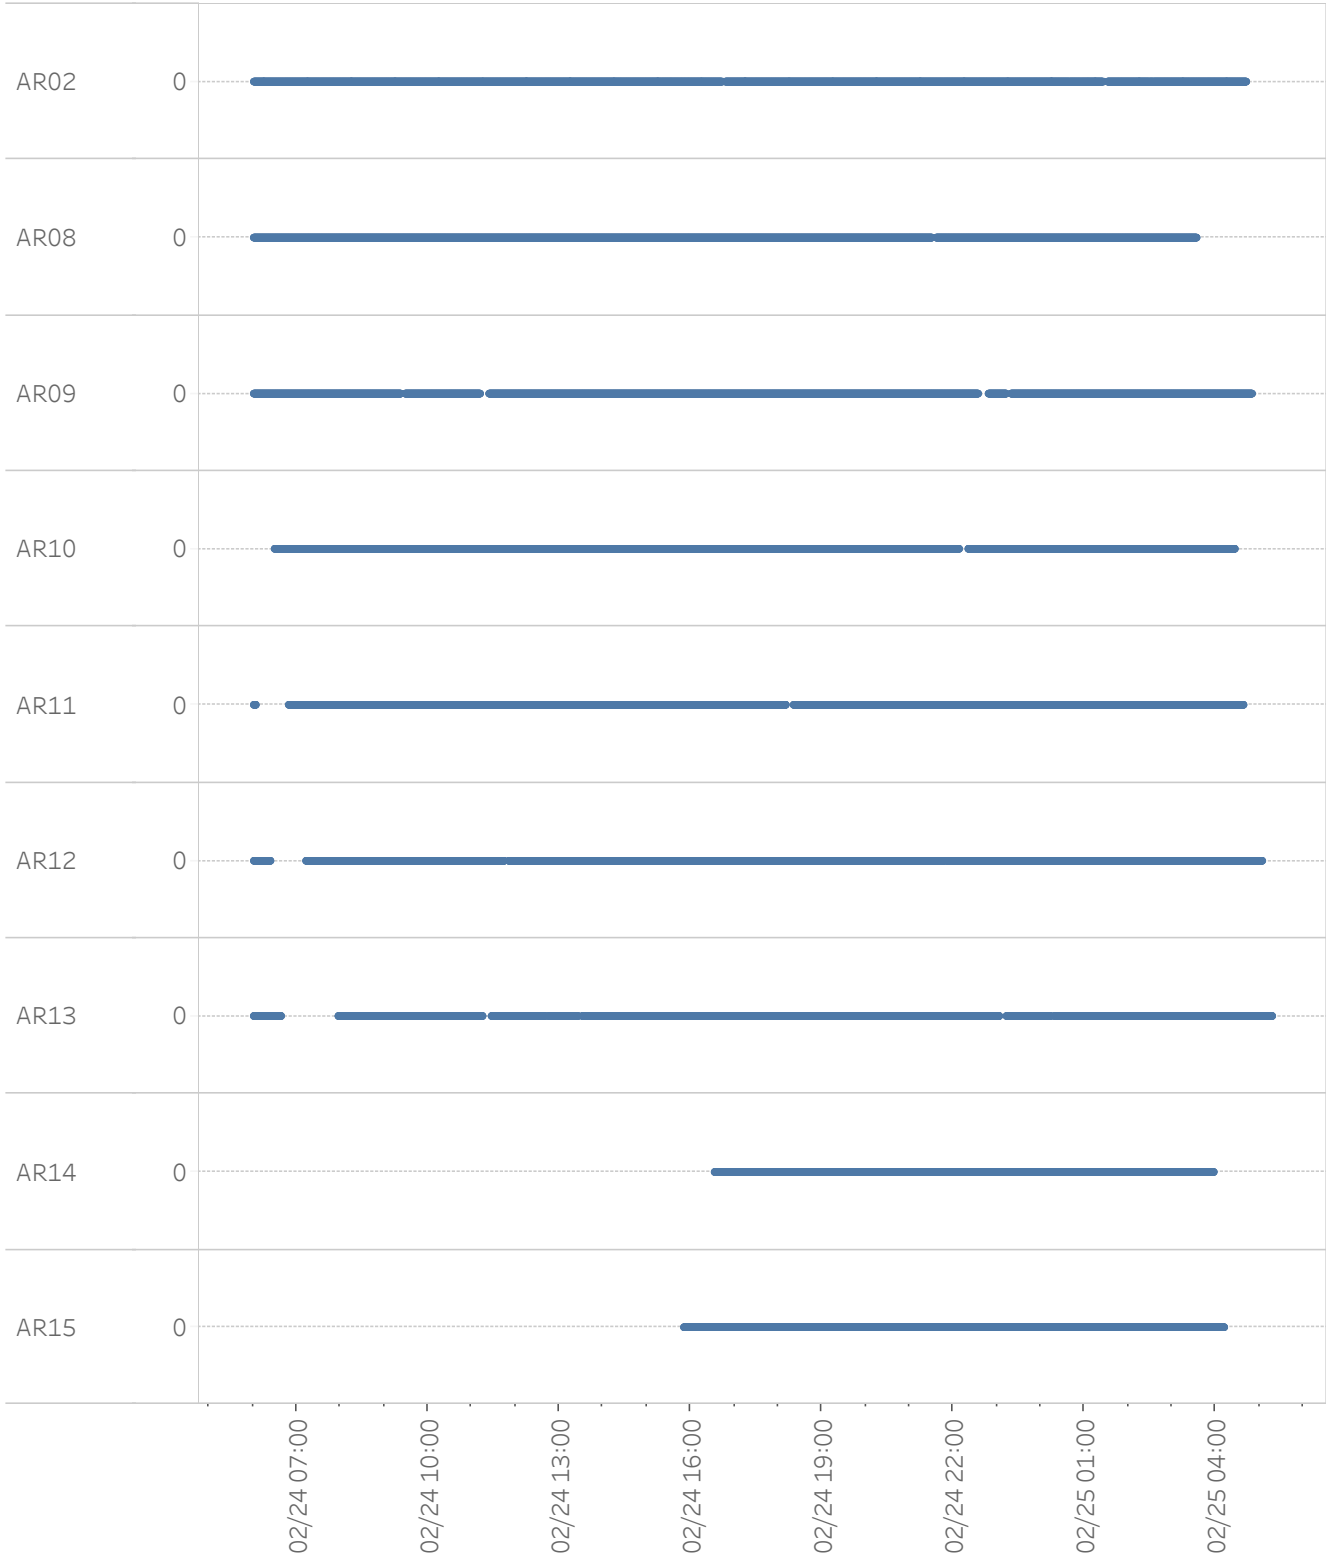

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA


2/24/2025 6:00:03 AM to 2/25/2025 5:16:36 AM | **Analyte: H2S (ppm)**

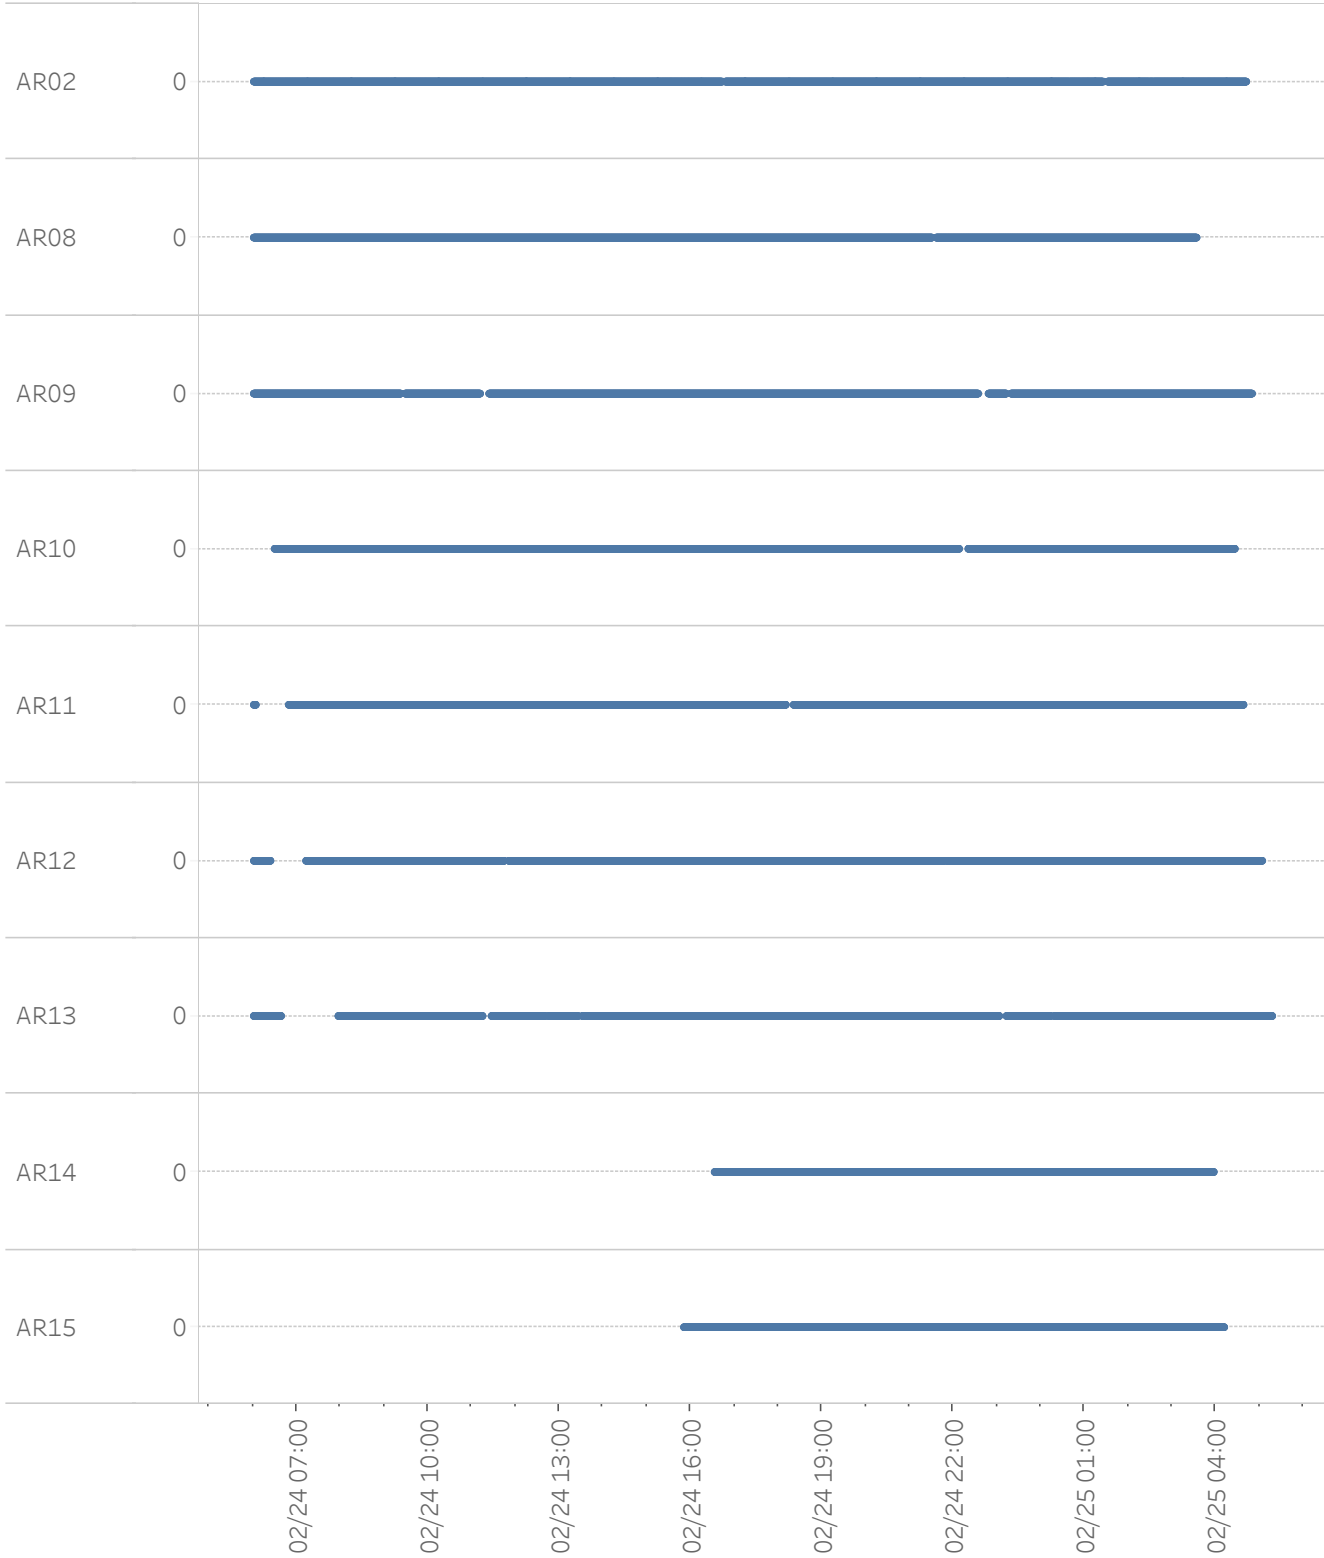

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA


2/24/2025 6:00:03 AM to 2/25/2025 5:16:36 AM | **Analyte: LEL (%)**

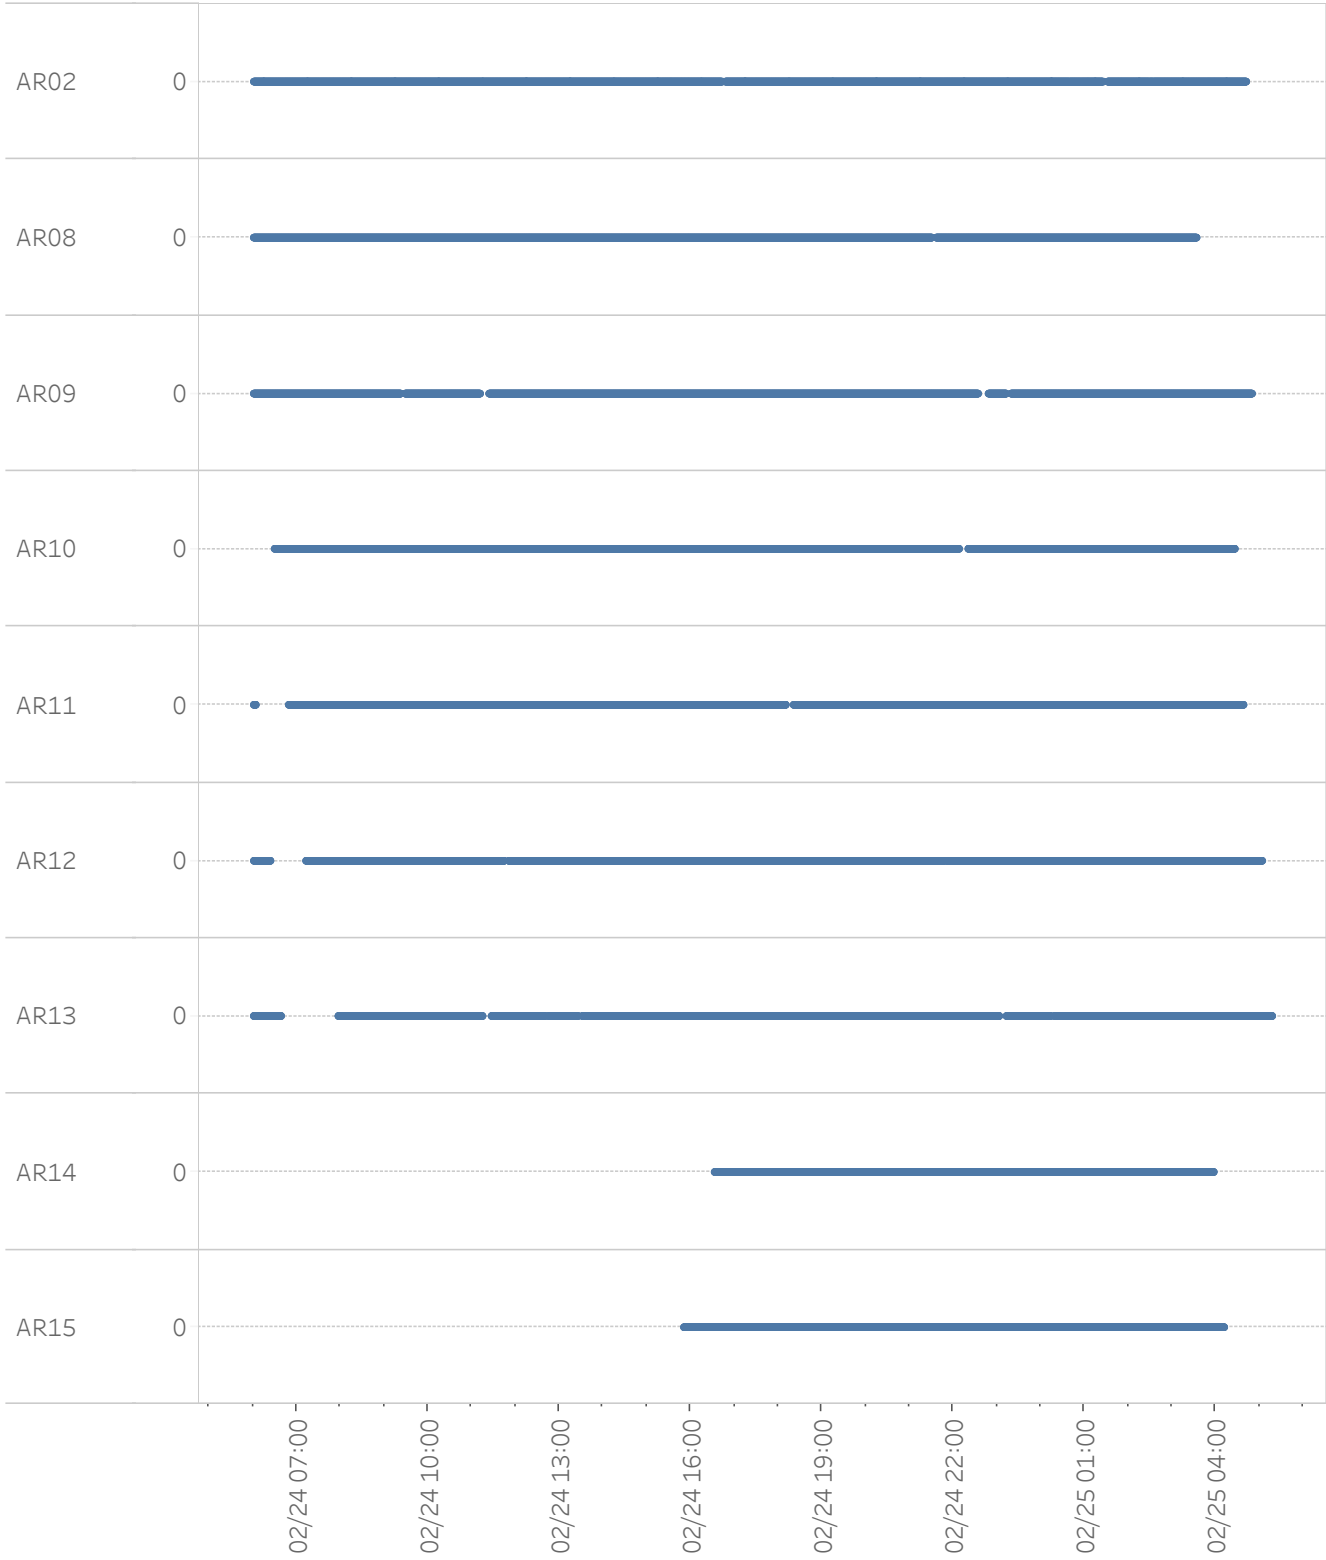

Preliminary Fixed Station Real-time Air Monitoring Readings

PROJ-052216 | Expanded Community | SPS Technologies Fire | Abington Township, PA


2/24/2025 6:00:03 AM to 2/25/2025 5:16:36 AM | Analyte: VOCs (ppm)

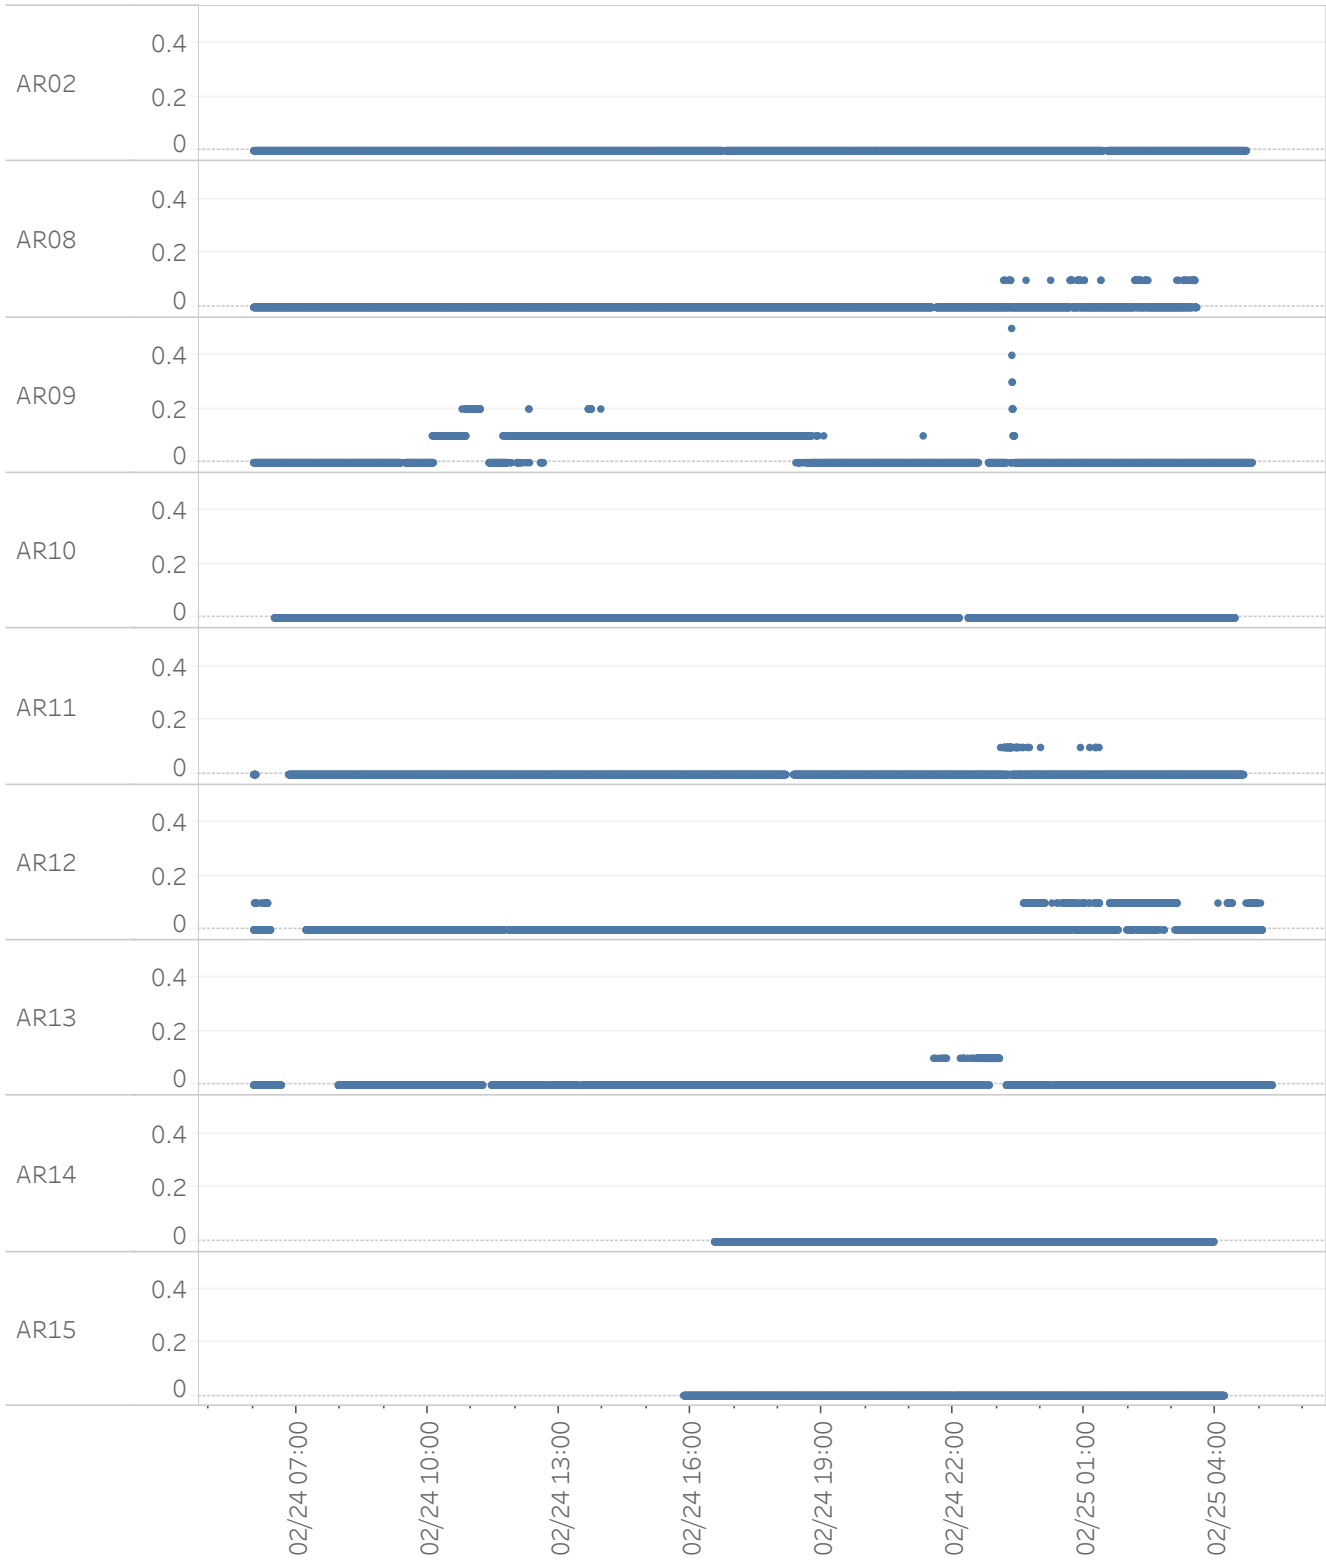

PROJ-052216 | PM2.5 Graph | Expanded Community

SPS Technologies Fire | Abington Township, PA

02/24 05:00 to 02/25 04:59

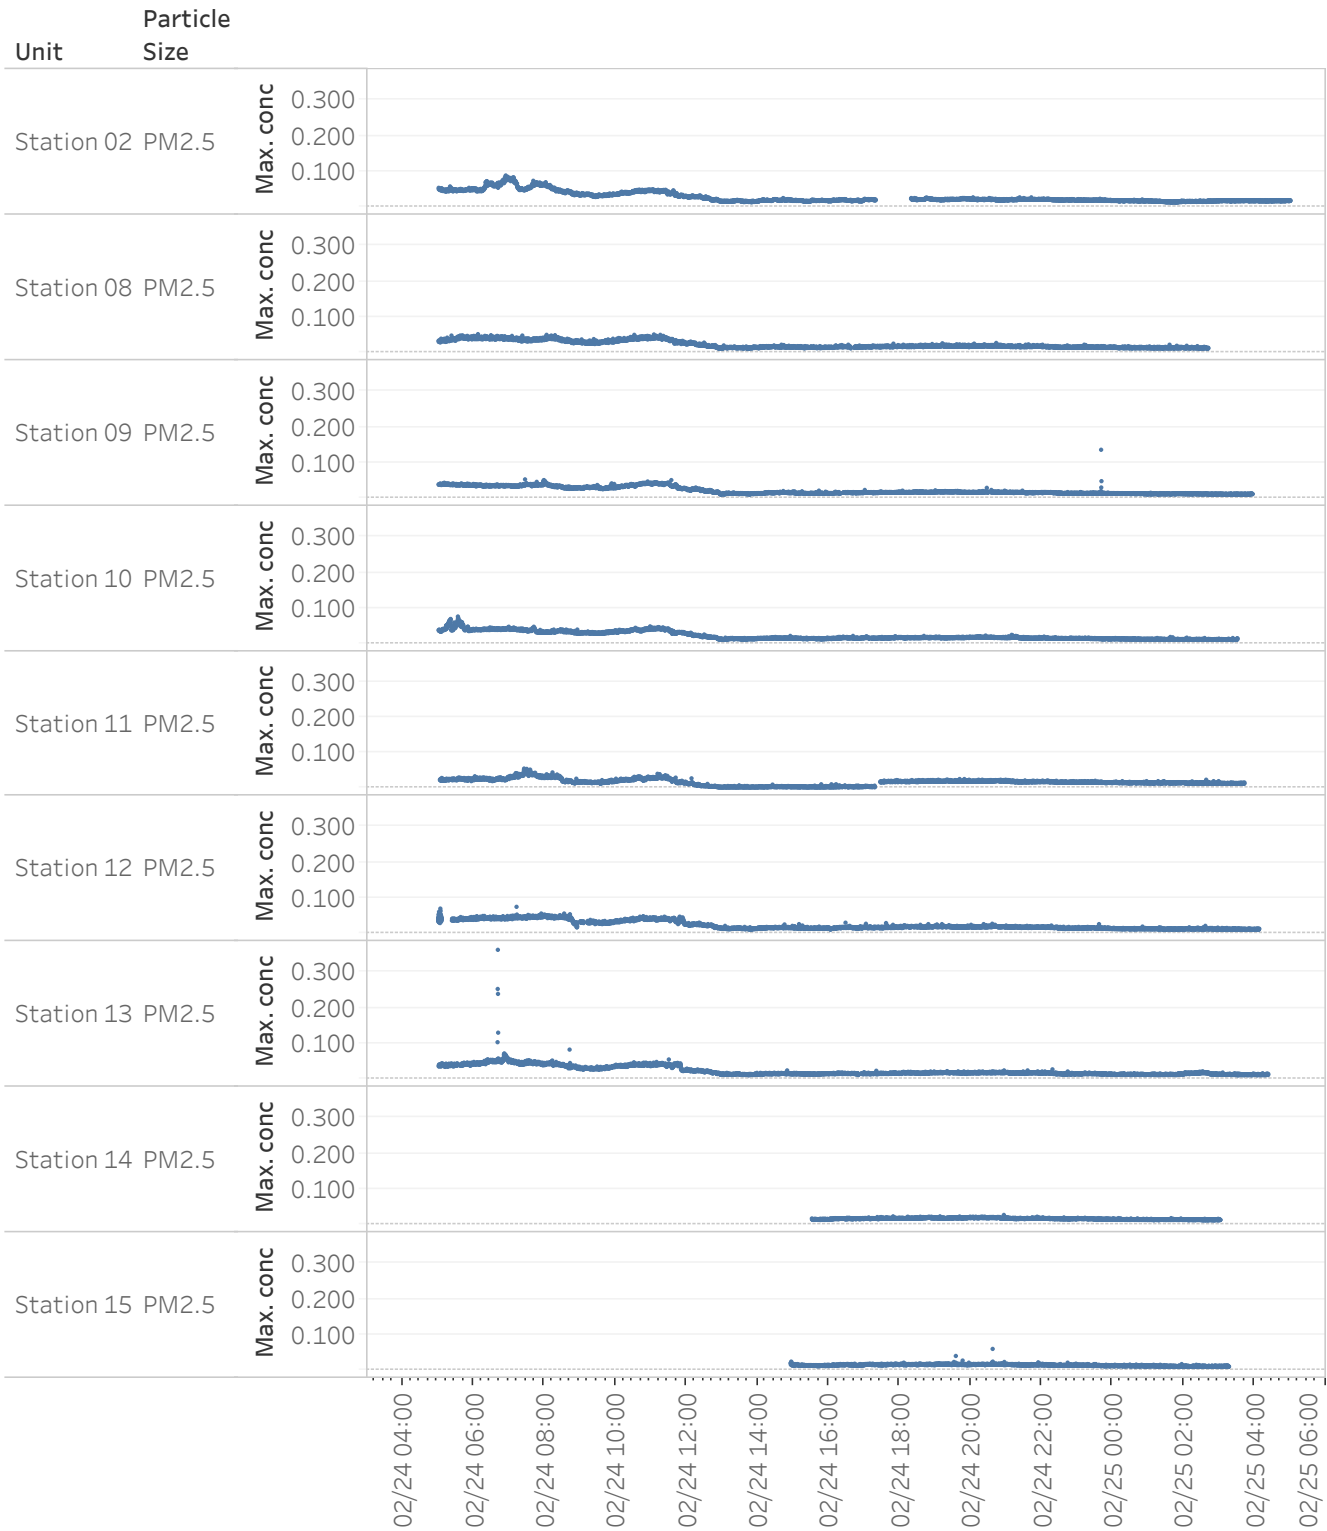

PROJ-052216 Summary Table | PM2.5 | Expanded Community

Unit	Particle Size	Count of Records	Count of Detections	Min. concentration	Max. concentration	Avg. concentration
Station 02	PM2.5	5,510	5,510	0.011	0.087	0.025
Station 08	PM2.5	5,183	5,183	0.008	0.050	0.021
Station 09	PM2.5	5,484	5,484	0.008	0.135	0.019
Station 10	PM2.5	5,380	5,380	0.008	0.075	0.020
Station 11	PM2.5	5,398	4,813	0.000	0.053	0.014
Station 12	PM2.5	5,687	5,687	0.008	0.073	0.022
Station 13	PM2.5	5,593	5,593	0.008	0.364	0.021
Station 14	PM2.5	2,763	2,763	0.010	0.025	0.014
Station 15	PM2.5	2,965	2,965	0.007	0.058	0.012

Attachment D

Meteorological Conditions

